

Regulation GB – 4.0 Green Building Regulations (LEED-NC-v3.0)

Regulation GB – 4.1: Site Selection

- 4.1.1 General
- 4.1.2 SS Prerequisite 1: Construction Activity Pollution Prevention
- 4.1.3 SS Credit 1: Site Selection
- 4.1.4 SS Credit 2: Development Density & Community Connectivity
- 4.1.5 SS Credit 3: Brownfield Redevelopment
- 4.1.6 SS Credit 4.1: Alternative Transportation: Public Transportation Access
- 4.1.7 SS Credit 4.2: Alternative Transportation: Bicycle Storage & Changing Rooms
- 4.1.8 SS Credit 4.3: Alternative Transportation: Low Emitting & Fuel Efficient Vehicles
- 4.1.9 SS Credit 4.4: Alternative Transportation: Parking Capacity
- 4.1.10 SS Credit 5.1: Site Development-Protect or Restore Habitat
- 4.1.11 SS Credit 5.2: Site Development: Maximize Open Space
- 4.1.12 SS Credit 6.1: Storm water Design—Quantity Control
- 4.1.13 SS Credit 6.2: Storm water Design—Quality Control
- 4.1.14 SS Credit 7.1: Heat Island Effect—Non Roof
- 4.1.15 SS Credit 7.2: Heat Island Effect—Roof
- 4.1.16 SS Credit 8: Light Pollution Reduction

Regulation GB-4.2: Water Efficiency

- 4.2.1 General Provisions
- 4.2.2 WE Prerequisite -Water Use Reduction
- 4.2.3 WE Credit 1: Water Efficient Landscaping
- 4.2.4 WE Credit 2: Innovative Wastewater Technologies
- 4.2.5 WE Credit 3: Water Use reduction

Regulation GB-4.3: Energy & Atmosphere

- 4.3.1 EA Prerequisite 1: Fundamental Commissioning of Building Energy Systems
- 4.3.2 EA Prerequisite 2: Minimum Energy Performance
- 4.3.3 EA Prerequisite 3: Fundamental Refrigerant Management
- 4.3.4 EA Credit 1: Optimize Energy Performance
- 4.3.5 EA Credit 2: On-site Renewable Energy
- 4.3.6 EA Credit 3: Enhanced Commissioning
- 4.3.7 EA Credit 4: Enhanced Refrigerant Management
- 4.3.8 EA Credit 5: Measurement and Verification
- 4.3.9 EA Credit 6: Green Power

Regulation GB-4.4: Materials & Resources

- 4.4.1 MR Prerequisite 1: Storage and Collection of Recyclables Required
- 4.4.2 MR Credit 1.1: Building Reuse
- 4.4.3 MR Credit 1.2: Building Reuse—Maintain Interior Nonstructural Elements
- 4.4.4 MR Credit 2: Construction Waste Management
- 4.4.5 MR Credit 3: Materials Reuse
- 4.4.6 MR Credit 4: Recycled Content
- 4.4.7 MR Credit 5: Regional Materials
- 4.4.8 MR Credit 6: Rapidly Renewable Materials
- 4.4.9 MR Credit 7: Certified Wood

Regulation GB-4.5: Indoor Environmental Quality

- 4.5.1 Prerequisite 1: Minimum Indoor Air Quality Performance
- 4.5.2 Prerequisite 2: Environmental Tobacco Smoke (ETS) Control
- 4.5.3 Credit 1: Outdoor Air Delivery Monitoring
- 4.5.4 Credit 2: Increased Ventilation
- 4.5.5 Credit 3.1: Construction Indoor Air Quality Management Plan—During Construction
- 4.5.6 Credit 3.2: Construction Indoor Air Quality Management Plan—Before Occupancy
- 4.5.7 Credit 4.1: Low-Emitting Materials—Adhesives and Sealants
- 4.5.8 IEQ Credit 4.2: Low-Emitting Materials—Paints and Coatings
- 4.5.9 IEQ Credit 4.3: Low-Emitting Materials—Flooring Systems
- 4.5.10 IEQ Credit 4.4: Low-Emitting Materials—Composite Wood and Agrifiber Products
- 4.5.11 IEQ Credit 5: Indoor Chemical and Pollutant Source Control
- 4.5.12 IEQ Credit 6.1: Controllability of Systems—Lighting
- 4.5.13 IEQ Credit 6.2: Controllability of Systems—Thermal Comfort
- 4.5.14 IEQ Credit 7.1: Thermal Comfort—Design
- 4.5.15 IEQ Credit 7.2: Thermal Comfort—Verification
- 4.5.16 IEQ Credit 8.1: Daylight and Views—Daylight
- 4.5.17 IEQ Credit 8.2: Daylight and Views—Views

Regulation GB-4.6: Innovation

- 4.6.1 ID Credit 1: Innovation in Design
- 4.6.2 ID Credit 2: LEED Accredited Professional - 1 Point [EHS Mandatory]

Regulation GB-4.7: EHS Green Building Regulations (Workup Table)

- 4.7.1 SUSTAINABLE SITES (26 POSSIBLE POINTS)
- 4.7.2 WATER EFFICIENCY (10 POSSIBLE POINTS)
- 4.7.3 ENERGY & ATMOSPHERE (35 POSSIBLE POINTS)
- 4.7.4 MATERIALS & RESOURCES (14 POSSIBLE POINTS)
- 4.7.5 Indoor Environmental Quality (15 POSSIBLE POINTS)
- 4.7.6 INNOVATION IN DESIGN (6 POSSIBLE POINTS)

Regulation GB – 4.1: Site Selection

4.1.1 General

This category of credits is intended to reduce environmental damage, pollution and other harmful effects due to building construction. Buildings affect ecosystems in a variety of ways. Development projects must be sensitive to encroaching on agricultural lands, compromising existing wildlife habitat and exacerbating regional and local erosion.

4.1.2 SS Prerequisite 1: Construction Activity Pollution Prevention – Required [EHS Mandatory]

Intent

Reduce pollution from construction activities by controlling soil erosion, waterway sedimentation and airborne dust penetration.

Requirements

Create and implement an erosion and sedimentation control plan for all construction activities associated with the project. The plan must conform to the local erosion and sedimentation control standards and codes.

The plan must describe the measures implemented to accomplish the following objectives.

- To prevent loss of soil during construction by storm water runoff and/or wind erosion, including protecting topsoil by stockpiling for reuse.
- To prevent sedimentation of storm sewers or receiving streams.
- To prevent pollution of the air with dust and particulate matter.

Potential Technologies & Strategies

Create an erosion and sedimentation control plan during the design phase of the project. Consider employing strategies such as temporary and permanent seeding, mulching, earthen dikes, silt fencing, sediment traps and sediment basins.

4.1.3 SS Credit 1: Site Selection - 1 Point [EHS MANDATORY]

Intent

Avoid development of inappropriate sites and reduce the environmental impact from the location of a building on a site.

Requirements

Do not develop buildings, hardscape, roads or parking areas on portions of sites that meet any one of the following criteria:

- Prime farmland as identified by Dubai Municipality.
- Previously undeveloped land whose elevation is lower than 5 feet above the elevation of the 100-year flood
- Land that is specifically identified as habitat for any species of threatened or endangered lists
- Within 100 feet of any wetlands and isolated wetlands or areas of special concern identified by state or local rule, OR within setback distances from wetlands prescribed in state or local regulations, as defined by local or state rule or law, whichever is more stringent
- Previously undeveloped land that is within 50 feet of a water body, defined as seas, lakes, rivers, streams and tributaries which support or could support fish, recreation or industrial use.
- Land which prior to acquisition for the project was public parkland, unless land of equal or greater value as parkland is accepted in trade.

Potential Technologies & Strategies

During the site selection process, give preference to those sites that do not include sensitive site elements and restrictive land types. Select a suitable building location and design the building with the minimal footprint to minimize site disruption of those environmentally sensitive areas identified above.

4.1.4 SS Credit 2: Development Density & Community Connectivity – 5 points

Intent

Channel development to urban areas with existing infrastructure, protect Greenfield and preserve habitat and natural resources.

Requirements

OPTION 1 — DEVELOPMENT DENSITY

Construct or renovate building on a previously developed site AND in a community with a minimum density of 60,000 square feet per acre net (Note: density calculation must include the area of the project being built and is based on a typical two-story downtown development).

OR

OPTION 2 — COMMUNITY CONNECTIVITY

Construct or renovate building on a previously developed site AND within 1/2 mile of a

residential zone or neighborhood with an average density of 10 units per acre net AND within 1/2 mile of at least 10 Basic Services AND with pedestrian access between the building and the services.

Basic Services include, but are not limited to:

1) Bank; 2) Place of Worship; 3) Convenience Grocery; 4) Day Care; 5) Cleaners; 6) Fire Station; 7) Beauty; 8) Hardware; 9) Laundry; 10) Library; 11) Medical/Dental; 12) Senior Care Facility; 13) Park; 14) Pharmacy; 15) Post Office; 16) Restaurant; 17) School; 18) Supermarket; 19) Theater; 20) Community Center; 21) Fitness Center; 22) Museum.

Proximity is determined by drawing a 1/2 mile radius around the main building entrance on a site map and counting the services within that radius.

Potential Technologies & Strategies

During the site selection process, give preference to urban sites with pedestrian access to a variety of services.

4.1.5 SS Credit 3: Brownfield Redevelopment - 1 point

Intent

Rehabilitate damaged sites where development is complicated by environmental contamination, reducing pressure on undeveloped land.

Requirements

OPTION 1

Develop on a site documented as contaminated (by means of an ASTM E1903-97 Phase II Environmental Site Assessment or a local Voluntary Cleanup Program).

OR

OPTION 2

Develop on a site defined as a Brownfield by a local, state or federal government agency.

Potential Technologies & Strategies

During the site selection process, give preference to Brownfield sites. Identify tax incentives and property cost savings. Coordinate site development plans with remediation activity, as appropriate.

4.1.6 SS Credit 4.1: Alternative Transportation: Public Transportation Access - 6 points

Intent

Reduce pollution and land development impacts from automobile use.

Requirements

OPTION 1. Rail Station Proximity

Locate project within 1/2 mile of an existing, or planned and funded, commuter rail, light rail or subway station.

OR

OPTION 2. Bus Stop Proximity

Locate project within 1/4 mile of one or more stops for two or more public or campus bus lines usable by building occupants.

Potential Technologies & Strategies

Perform a transportation survey of future building occupants to identify transportation needs. Site the building near mass transit.

4.1.7 SS Credit 4.2: Alternative Transportation: Bicycle Storage & Changing Rooms – 1 point

Intent

Reduce pollution and land development impacts from automobile use.

Requirements

CASE1. For commercial or institutional buildings, provide secure bicycle racks and/or storage (within 200 yards of a building entrance) for 5% or more of all building users (measured at peak periods), AND, provide shower and changing facilities in the building, or within 200 yards of a building entrance, for 0.5% of Full-Time Equivalent (FTE) occupants.

OR

CASE 2. For residential buildings, provide covered storage facilities for securing bicycles for 15% or more of building occupants in lieu of changing/shower facilities.

Potential Technologies & Strategies

Design the building with transportation amenities such as bicycle racks and showering /changing facilities.

4.1.8 SS Credit 4.3: Alternative Transportation: Low Emitting & Fuel Efficient Vehicles – 3 points

Intent

Reduce pollution and land development impacts from automobile use.

Requirements

OPTION 1

Provide low-emitting and fuel-efficient vehicles for 3% of Full-Time Equivalent (FTE) occupants AND provide preferred parking for these vehicles.

OR

OPTION 2

Provide preferred parking for low-emitting and fuel-efficient vehicles for 5% of the total vehicle parking capacity of the site.

OR

OPTION 3

Install alternative-fuel refueling stations for 3% of the total vehicle parking capacity of the site (liquid or gaseous fueling facilities must be separately ventilated or located outdoors).

For the purposes of this credit, low-emitting and fuel-efficient vehicles are defined as vehicles that are either classified as Zero Emission Vehicles (ZEV) by the California Air Resources Board or have achieved a minimum green score of 40 on the American Council for an Energy Efficient Economy (ACEEE) annual vehicle rating guide.

“Preferred parking” refers to the parking spots that are closest to the main entrance of the project (exclusive of spaces designated for handicapped) or parking passes provided at a discounted price.

Potential Technologies & Strategies

Provide transportation amenities such as alternative fuel refueling stations. Consider sharing the costs and benefits of refueling stations with neighbors.

4.1.9 SS Credit 4.4: Alternative Transportation: Parking Capacity-2 Points [EHS MANDATORY]

Intent

Reduce pollution and land development impacts from single occupancy vehicle use.

Requirements

CASE 1. Non-Residential Projects

OPTION 1

Size parking capacity must meet but not exceed minimum local zoning requirements.

Provide preferred parking for carpools or vanpools for 5% of the total parking spaces.

OR

OPTION 2

For projects that provide parking for less than 5% of full-time equivalent (FTE) building occupants:

Provide preferred parking¹ for carpools or vanpools, marked as such, for 5% of total parking spaces. Providing a discounted parking rate is an acceptable substitute for preferred parking for carpool or vanpool vehicles. To establish a meaningful incentive in all potential markets, the parking rate must be discounted at least 20%. The discounted rate must be available to all customers (i.e., not limited to the number of customers equal to 5% of the vehicle parking capacity), publicly posted at the entrance of the parking area, and available for a minimum of 2 years.

OR

OPTION 3

Provide no new parking.

CASE 2. Residential Projects

OPTION 1

Size parking capacity to meet but not exceed minimum local zoning requirements.

Provide infrastructure and support programs to facilitate shared vehicle use such as carpool drop-off areas, designated parking for vanpools, car-share services, ride boards and shuttle services to mass transit.

OR

OPTION 2

Provide no new parking.

CASE 3. Mixed Use (Residential with Commercial/Retail) Projects

OPTION 1

Mixed-use buildings with less than 10% commercial area must be considered residential and adhere to the residential requirements in Case 2. For mixed-use buildings with more than 10% commercial area, the commercial space must adhere to non-residential requirements in Case 1 and the residential component must adhere to residential requirements in Case 2.

OR

OPTION 2

Provide no new parking.

“Preferred parking” refers to the parking spots that are closest to the main entrance of the project (exclusive of spaces designated for handicapped) or parking passes provided at a discounted price.

Potential Technologies & Strategies

Minimize parking lot/garage size. Consider sharing parking facilities with adjacent buildings.
Consider alternatives that will limit the use of single occupancy vehicles.

4.1.10 SS Credit 5.1: Site Development-Protect or Restore Habitat 1 Point [EHS MANDATORY]

Intent

Conserve existing natural areas and restore damaged areas to provide habitat and promote biodiversity.

Requirements

CASE 1. Greenfield Sites1

Limit all site disturbances to the following parameters:

- 40 feet beyond the building perimeter;
- 10 feet beyond surface walkways, patios, surface parking and utilities less than 12 inches in diameter;
- 15 feet beyond primary roadway curbs and main utility branch trenches;
- 25 feet beyond constructed areas with permeable surfaces (such as pervious paving areas, storm water detention facilities and playing fields) that requires additional staging areas to limit compaction in the constructed area.

CASE 2. Previously Developed2 Areas or Graded Sites

Restore or protect a minimum of 50% of the site (excluding the building footprint) or 20% of the total site area (including building footprint), whichever is greater, with native or adapted vegetation3. Projects earning SS Credit 2: Development Density and Community Connectivity may include vegetated roof surface in this calculation if the plants are native or adapted, provide habitat, and promote biodiversity.

Potential Technologies & Strategies

Survey Greenfield sites to identify site elements and adopt a master plan for developing the project site. Carefully site the building to minimize disruption to existing ecosystems and design the building to minimize its footprint. Strategies include stacking the building program, tuck-under parking and sharing parking facilities with neighbors. Establish clearly-marked construction boundaries to minimize disturbance of the existing site and restore previously degraded areas to their natural state. For previously developed sites, use local and regional governmental agencies, consultants, educational facilities and native plant societies as resources for the selection of appropriate native or adapted plants. Prohibit plants listed as invasive or noxious weed species. Once established, native/adapted plants require minimal or

no irrigation; do not require active maintenance such as mowing or chemical inputs such as fertilizers, pesticides or herbicides; and provide habitat value and promote biodiversity through avoidance of monoculture plantings.

1-Greenfield sites are those that are not previously developed or graded and remain in a natural state.

2- Previously developed areas are those that previously contained buildings, roadways, parking lots or were graded or altered by direct human activities.

3 -Native or adapted plants are plants indigenous to a locality or cultivars of native plants that are adapted to the local climate and are not considered invasive species

Or noxious weeds.

4.1.11 SS Credit 5.2: Site Development: Maximize Open Space – 1 point

Intent

Provide a high ratio of open space to development footprint to promote biodiversity.

Requirements

CASE 1. Sites with Local Zoning Open Space Requirements

Reduce the development footprint¹ and/or provide vegetated open space within the project boundary such that the amount of open space exceeds local zoning requirements by 25%.

CASE 2. Sites with No Local Zoning Requirements (e.g. some university campuses, military bases)

Provide a vegetated open space area adjacent to the building that is equal in area to the building footprint.

CASE 3. Sites with Zoning Ordinances but No Open Space Requirements

Provide vegetated open space equal to 20% of the project site area.

ALL CASES

For projects in urban areas that earn SS Credit 2: Development Density and Community Connectivity, vegetated roof areas can contribute to credit compliance.

For projects in urban areas that earn SS Credit 2: Development Density and Community Connectivity, pedestrian-oriented hardscape areas can contribute to credit compliance. For such projects, a minimum of 25% of the open space counted must be vegetated.

Wetlands or naturally designed ponds may count as open space and the side slope gradients average 1:4 (vertical: horizontal) or less and are vegetated.

Potential Technologies & Strategies

Perform a site survey to identify site elements and adopt a master plan for developing the project site. Select a suitable building location and design the building footprint to minimize site

disruption. Strategies include stacking the building program, tuck-under parking and sharing parking facilities with neighbors to maximize the amount of open space on the site.

4.1.12 SS Credit 6.1: Storm water Design—Quantity Control – 1 point

Intent

To limit disruption of natural hydrology by reducing impervious cover, increasing on-site infiltration, reducing or eliminating pollution from storm water runoff and eliminating contaminants.

Requirements

CASE 1. Sites with Existing Imperviousness 50% or Less

OPTION 1

Implement a storm water management plan that prevents the post development peak discharge rate and quantity from exceeding the predevelopment peak discharge rate and quantity for the 1- and 2-year 24-hour design storms.

OR

OPTION 2

Implement a storm water management plan that protects receiving stream channels from excessive erosion. The storm water management plan must include stream channel protection and quantity control strategies.

CASE 2. Sites with Existing Imperviousness Greater Than 50%

Implement a storm water management plan that results in a 25% decrease in the volume of storm water runoff from the 2-year 24-hour design storm.

Potential Technologies & Strategies

Design the project site to maintain natural storm water flows by promoting infiltration. Specify vegetated roofs, pervious paving and other measures to minimize impervious surfaces. Reuse storm water for non-potable uses such as landscape irrigation, toilet and urinal flushing, and custodial uses.

4.1.13 SS Credit 6.2: Storm water Design—Quality Control – 1 point

Intent

Limit disruption and pollution of natural water flows by managing storm water runoff.

Requirements

Implement a storm water management plan that reduces impervious cover, promotes infiltration and captures and treats the storm water runoff from 90% of the average annual rainfall¹ using

acceptable best management practices (BMPs). BMPs used to treat runoff must be capable of removing 80% of the average annual post development total suspended

Solids (TSS) load based on existing monitoring reports. BMPs are considered to meet these criteria if:

They are designed in accordance with standards and specifications from a state or local program that has adopted these performance standards,

OR

There exists infield performance monitoring data demonstrating compliance with the criteria.

Potential Technologies & Strategies

Use alternative surfaces (e.g., vegetated roofs, pervious pavement, grid pavers) and nonstructural techniques (e.g., rain gardens, vegetated swales, disconnection of imperviousness, rainwater recycling) to reduce imperviousness and promote infiltration and thereby reduce pollutant loadings.

Use sustainable design strategies (e.g., low-impact development, environmentally sensitive design) to create integrated natural and mechanical treatment systems such as constructed wetlands, vegetated filters and open channels to treat storm water runoff.

4.1.14 SS Credit 7.1: Heat Island Effect—Non Roof 1 Point [EHS MANDATORY]

Intent

To reduce heat islands¹ to minimize impacts on microclimates and human and wildlife habitats.

Requirements

OPTION 1

Use any combination of the following strategies for 50% of the site hardscape (including roads, sidewalks, courtyards and parking lots):

- Provide shade from the existing tree canopy or within 5 years of landscape installation. Landscaping (trees) must be in place at the time of occupancy.
- Provide shade from structures covered by solar panels that produce energy used to offset some nonrenewable resource use.
- Provide shade from architectural devices or structures that have a solar reflectance index² (SRI) of at least 29.
- Use hardscape materials with an SRI of at least 29.
- Use an open-grid pavement system (at least 50% pervious).

OR

OPTION 2

Place a minimum of 50% of parking spaces under cover³. Any roof used to shade or cover parking must have an SRI of at least 29, be a vegetated green roof or be covered by solar panels that produce energy used to offset some nonrenewable resource use.

Heat islands are defined as thermal gradient differences between developed and undeveloped areas.

* The solar reflectance index (SRI) is a measure of the constructed surface's ability to reflect solar heat, as shown by a small temperature rise. It is defined so that a standard black surface (reflectance 0.05, emittance 0.90) is 0 and a standard white surface (reflectance 0.80, emittance 0.90) is 100. To calculate the SRI for a given material, obtain the reflectance value and emittance value for the material. SRI is calculated according to ASTM E 1980. Reflectance is measured according to ASTM E 903, ASTM E 1918, or ASTM C 1549. Emittance is measured according to ASTM E 408 or ASTM C 1371.

* For the purposes of this credit, under cover parking is defined as parking underground, under deck, under roof, or under a building.

Potential Technologies & Strategies

Employ strategies, materials and landscaping techniques that reduce the heat absorption of exterior materials. Use shade (calculated on June 21, noon solar time) from native or adapted trees and large shrubs, vegetated trellises or other exterior structures supporting vegetation. Consider using new coatings and integral colorants for asphalt to achieve light-colored surfaces instead of blacktop. Position photovoltaic cells to shade impervious surfaces.

Consider replacing constructed surfaces (e.g., roof, roads, sidewalks, etc.) with vegetated surfaces such as vegetated roofs and open grid paving or specify high-albedo materials, such as concrete, to reduce heat absorption.

4.1.15 SS Credit 7.2: Heat Island Effect—Roof 1 Point [EHS MANDATORY]

Intent

To reduce heat islands¹ to minimize impacts on microclimates and human and wildlife habitats.

Requirements

OPTION 1

Use roofing materials with a solar reflectance index (SRI) equal to or greater than the values in the table below for a minimum of 75% of the roof surface.

Roofing materials having a lower SRI value than those listed below may be used if the weighted rooftop SRI average meets the following criteria:

$$\frac{\text{Area Roof Meeting Minimum SRI}}{\text{Total Roof Area}} \times \frac{\text{SRI of Installed Roof}}{\text{Required SRI}} \geq 75\%$$

Roof Type	Slope	SRI
Low-sloped roof	≤ 2:12	78
Steep-sloped roof	> 2:12	29

OR

OPTION 2

Install a vegetated roof that covers at least 50% of the roof area.

OR

OPTION 3

Install high-albedo and vegetated roof surfaces that, in combination, meet the following criteria:

$$\frac{\text{Area Roof Meeting Minimum SRI}}{0.75} + \frac{\text{Area of Vegetated Roof}}{0.5} \geq \text{Total Roof Area}$$

Roof Type	Slope	SRI
Low-sloped roof	≤ 2:12	78
Steep-sloped roof	> 2:12	29

Potential Technologies & Strategies

Consider installing high-albedo and vegetated roofs to reduce heat absorption. Default values will be available in the LEED Reference Guide for Green Building Design and Construction, 2009 Edition. Product information is available from the Cool Roof Rating Council Web site at <http://www.coolroofs.org/> and the ENERGY STAR® Web site at <http://www.energystar.gov/>.

4.1.16 SS Credit 8: Light Pollution Reduction - 1 Point [EHS MANDATORY]

Intent

To minimize light trespass from the building and site, reduce sky-glow to increase night sky access, improve nighttime visibility through glare reduction and reduce development impact from lighting on nocturnal environments.

Requirements

Project teams must comply with 1 of the 2 options for interior lighting AND the requirement for exterior lighting.

For Interior Lighting

OPTION 1

Reduce the input power (by automatic device of) all non emergency interior luminaires with a direct line of sight to any openings in the envelope (translucent or transparent) by at least 50% between 11 p.m. and 5 a.m. After-hours override may be provided by a manual or occupant-sensing device provided the override lasts no more than 30 minutes.

OR

OPTION 2

All openings in the envelope (translucent or transparent) with a direct line of sight to any non emergency luminaires must have shielding (controlled/closed by automatic device for a resultant transmittance of less than 10% between 11 p.m. and 5 a.m.).

For Exterior Lighting

Light areas only as required for safety and comfort. Lighting power densities must not exceed ANSI/ASHRAE/IESNA Standard 90.1-2007 (with errata but without addenda1) for the classified zone. Meet exterior lighting control requirements from ANSI /ASHRAE /IESNA Standard 90.1-2007 (with errata but without addenda) Exterior Lighting Section, without amendments.

Classify the project under 1 of the following zones, as defined in IESNA RP-33, and follow all the requirements for that zone:

LZ1: Dark (developed areas within national parks, state parks, forest land and rural areas)

Design exterior lighting so that all site and building-mounted luminaires produce a maximum initial illuminance value no greater than 0.01 horizontal and vertical foot-candles at the site boundary and beyond. Document that 0% of the total initial designed fixture lumens (sum total of all fixtures on site) are emitted at an angle of 90 degrees or higher from nadir (straight down).

LZ2: Low (primarily residential zones, neighborhood business districts, light industrial areas with limited nighttime use and residential mixed-use areas)

Design exterior lighting so that all site and building-mounted luminaires produce a maximum initial illuminance value no greater than 0.10 horizontal and vertical foot-candles at the site boundary and no greater than 0.01 horizontal foot-candles 10 feet beyond the site boundary. Document that no more than 2% of the total initial designed fixture lumens (sum total of all fixtures on site) are emitted at an angle of 90 degrees or higher from nadir (straight down).

LZ3: Medium (all other areas not included in LZ1, LZ2 or LZ4, such as commercial/ industrial, and high-density residential)

Design exterior lighting so that all site and building-mounted luminaires produce a maximum initial illuminance value no greater than 0.20 horizontal and vertical foot-candles at the site boundary and no greater than 0.01 horizontal foot-candles 15 feet beyond the site. Document that no more than 5% of the total initial designed fixture lumens (sum total of all fixtures on site) are emitted at an angle of 90 degrees or higher from nadir (straight down).

LZ4: High2 (high-activity commercial districts in major metropolitan areas)

Design exterior lighting so that all site and building-mounted luminaires produce a maximum initial illuminance value no greater than 0.60 horizontal and vertical foot-candles at the site boundary and no greater than 0.01 horizontal foot-candles 15 feet beyond the site. Document that no more than 10% of the total initial designed fixture lumens (sum total of all fixtures on site) are emitted at an angle of 90 degrees or higher from nadir (straight down).

LZ2, LZ3 and LZ4 - For site boundaries that abut public rights-of-way, light trespass requirements may be met relative to the curb line instead of the site boundary.

For All Zones

Illuminance generated from a single luminaire placed at the intersection of a private vehicular driveway and public roadway accessing the site is allowed to use the centerline of the public roadway as the site boundary for a length of 2 times the driveway width centered at the centerline of the driveway.

Potential Technologies & Strategies

Adopt site lighting criteria to maintain safe light levels while avoiding off-site lighting and night sky pollution. Minimize site lighting where possible, and use computer software to model the site lighting. Technologies to reduce light pollution include full cutoff luminaires, low-reflectance surfaces and low-angle spotlights.

Regulation GB-4.2: Water Efficiency

4.2.1 General Provisions

Water efficiency can be defined as the accomplishment of a function, task, process, or result with the minimal amount of water feasible. It is an indicator of the relationship between the amount of water required for a particular purpose and the amount of water used or delivered. Water efficiency is the long-term ethic of saving water resources through the employment of water-saving technologies and activities. Using water efficiently will help ensure supplies for future generations.

Though the two are often used interchangeably, there is a difference between water conservation and water efficiency. Water efficiency differs from water conservation in that it focuses on reducing waste. A proposition is that the key for efficiency is reducing waste, not restricting use. It also emphasizes the influence stakeholders and consumers can have in water efficiency by making small behavioral changes to reduce water wastage and by choosing more water efficient products. Examples of water efficient steps includes fixing leaking taps, taking showers rather than baths, installing displacements devices inside toilet cisterns, and using dishwashers and washing machines with full loads. These are things that fall under the definition of water efficiency, as their purpose is to obtain the desired result or level of service with the least necessary water

4.2.2 WE Prerequisite -Water Use reduction - Required [EHS Mandatory]

Intent

To increase water efficiency within buildings to reduce the burden on municipal water supply and wastewater systems.

Requirements

Employ strategies that in aggregate use 20% less water than the water use baseline calculated for the building (not including irrigation).

Calculate the baseline according to the commercial and/or residential baselines outlined below. Calculations are based on estimated occupant usage and must include only the following fixtures and fixture fittings (as applicable to the project scope): water closets, urinals, lavatory faucets, showers, kitchen sink faucets and pre-rinse spray valves.

Commercial Fixtures, Fittings, and Appliances	Current Baseline
Commercial toilets	1.6 gallons per flush (gpf)* Except blow-out fixtures: 3.5 (gpf)
Commercial urinals	1.0 (gpf)
Commercial lavatory (restroom) faucets	2.2 gallons per minute (gpm) at 60 pounds per square inch Private applications only (hotel or motel guest rooms, hospital patient rooms) 0.5 (gpm) at 60 (psi)** all others except private applications 0.25 gallons per cycle for metering faucets
Commercial pre rinse spray valves (for food service applications)	Flow rate \leq 1.6 (gpm) (no pressure specified; no performance requirement)
Residential Fixtures, Fittings, and Appliances	Current Baseline
Residential toilets	1.6 (gpf)***
Residential lavatory (bathroom) faucets	
Residential kitchen faucet	2.2 (gpm) at 60 psi
Residential showerheads	2.5 (gpm) at 80 (psi) per shower stall****

* EPA 1992 standard for toilets applies to both commercial and residential models.

** In addition to EPA requirements, the American Society of Mechanical Engineers standard for public lavatory faucets is 0.5 gpm at 60 psi (ASM E A112 .18.1-2005). This maximum has been incorporated into the national Uniform Plumbing Code and the International Plumbing Code.

*** EPA 1992 standard for toilets applies to both commercial and residential models.

**** Residential shower compartment (stall) in dwelling units: The total allowable flow rate from all flowing showerheads at any given time, including rain systems, waterfalls, body sprays, body spas and jets, must be limited to the allowable showerhead flow rate as specified above (2.5 gpm) per shower compartment, where the floor area of the shower compartment is less than 2,500 square inches. For each increment of 2,500 square inches of floor area thereafter or part thereof, an additional showerhead with total allowable flow rate from all flowing devices equal to or less than the allowable flow rate as specified above must be allowed. Exception: Showers that emit recirculated non potable water originating from within the shower compartment while operating are allowed to exceed the maximum as long as the total potable water flow does not exceed the flow rate as specified above.

The following fixtures, fittings and appliances are outside the scope of the water use reduction calculation:

- Commercial Steam Cookers
- Commercial Dishwashers
- Automatic Commercial Ice Makers
- Commercial (family sized) Clothes Washers
- Residential Clothes Washers
- Standard and Compact Residential Dishwashers

Potential Technologies & Strategies

Water Sense-certified fixtures and fixture fittings should be used where available. Use high-efficiency fixtures (e.g., water closets and urinals) and dry fixtures, such as toilets attached to composting systems, to reduce potable water demand. Consider using alternative on-site sources of water (e.g., rainwater, storm water, and air conditioner condensate) and gray water for non potable applications such as custodial uses and toilet and urinal flushing. The quality of any alternative source of water used must be taken into consideration based on its application or use.

4.2.3 WE Credit 1: Water Efficient Landscaping - 2–4 Points [EHS Mandatory(2 points)]

Intent

Limit or eliminate the use of potable water or other natural surface or subsurface water resources available on or near the project site for landscape irrigation.

Requirements

OPTION 1. Reduce by 50% (2 points)

Reduce potable water consumption for irrigation by 50% from a calculated midsummer baseline case.

Reductions must be attributed to any combination of the following items:

- Plant species, density and microclimate factor
- Irrigation efficiency

- Use of captured rainwater
- Use of recycled wastewater
- Use of water treated and conveyed by a public agency specifically for non potable uses

Groundwater seepage that is pumped away from the immediate vicinity of building slabs and foundations may be used for landscape irrigation to meet the intent of this credit. However, the project team must demonstrate that doing so does not affect site storm water management systems.

OR

OPTION 2. No Potable Water Use or Irrigation* (4 points)

Meet the requirements for Option 1.

AND

PATH 1

Use only captured rainwater, recycled wastewater, recycled gray water or water treated and conveyed by a public agency specifically for non potable uses for irrigation.

OR

PATH 2

Install landscaping that does not require permanent irrigation systems. Temporary irrigation systems used for plant establishment are allowed only if removed within 1 year of installation.

** If the percent reduction of potable water is 100% AND the percent reduction of total water is equal to or greater than 50%, both Option 1 and Option 2 are earned.*

Potential Technologies & Strategies

Perform a soil/climate analysis to determine appropriate plant material and design the landscape with native or adapted plants to reduce or eliminate irrigation requirements. Where irrigation is required, use high-efficiency equipment and/or climate-based controllers.

4.2.4 WE Credit 2: Innovative Wastewater Technologies - 2 Points [EHS Mandatory]

Intent

To reduce wastewater generation and potable water demand while increasing the local aquifer recharge.

Requirements

OPTION 1

Reduce potable water use for building sewage conveyance by 50% through the use of water-conserving fixtures (e.g., water closets, urinals) or non potable water (e.g., captured rainwater, recycled gray water, on-site or municipally treated wastewater).

OR

OPTION 2

Treat 50% of wastewater on-site to tertiary standards. Treated water must be infiltrated or used on-site.

Potential Technologies & Strategies

Specify high-efficiency fixtures and dry fixtures (e.g., composting toilet systems, non water-using urinals) to reduce wastewater volumes. Consider reusing storm water or gray water for sewage conveyance or on-site mechanical and/or natural wastewater treatment systems. Options for on-site wastewater treatment include packaged biological nutrient removal systems, constructed wetlands and high-efficiency filtration systems.

4.2.5 WE Credit 3: Water Use reduction - 2–4 Points [EHS Mandatory -2 Points]

Intent

To further increase water efficiency within buildings to reduce the burden on municipal water supply and wastewater systems.

Requirements

Employ strategies that in aggregate use less water than the water use baseline calculated for the building (not including irrigation). The minimum water savings percentage for each point threshold is as follows:

Percentage	Points
30%	2
35%	3
40%	4

Calculate the baseline according to the commercial and/or residential baselines outlined below.

Calculations are based on estimated occupant usage and must include only the following fixtures and fixture fittings (as applicable to the project scope): water closets, urinals, lavatory faucets, showers, kitchen sink faucets and pre-rinse spray valves.

Commercial Fixtures, Fittings, and Appliances	Current Baseline
Commercial toilets	1.6 gallons per flush (gpf)* Except blow-out fixtures: 3.5 (gpf)
Commercial urinals	1.0 (gpf)
Commercial lavatory (restroom) faucets	2.2 gallons per minute (gprn) at 60 pounds Private applications only (hotel or motel guest rooms, hospital patient rooms) 0.5 (gprn) at 60 (psi)** all others except private applications 0.25 gallons per cycle for metering faucets
Commercial pre-rinse spray (for food service)	Flow rate \leq 1.6 (gpm) (no pressure specified; no performance)

Residential Fixtures, Fittings, and Appliances	Current Baseline
Residential toilets	1.6 (gpf)***
Residential lavatory Residential kitchen faucet	2.2 (gprn) at 60 psi
Residential showerheads	2.5 (gprn) at 80 (psi) per shower stall****

* EPAAct 1992 standard for toilets applies to both commercial and residential models.

** In addition to EPAAct requirements, the American Society of Mechanical Engineers standard for public lavatory faucets is 0.5 gpm at 60 psi (ASM E A112 . 18.1-2005). This maximum has been incorporated into the national Uniform Plumbing Code and the International Plumbing Code

*** EPAAct 1992 standard for toilets applies to both commercial and residential models.

**** Residential shower compartment (stall) in dwelling units: The total allowable flow rate from all flowing showerheads at any given time, including rain systems, waterfalls, body sprays, body spas and jets, must be limited to the allowable showerhead flow rate as specified above (2.5 gpm) per shower compartment, where the floor area of the shower compartment is less than 2,500 square inches. For each increment of 2,500 square inches of floor area thereafter or part thereof, an additional showerhead with total allowable flow rate from all flowing devices equal to or less than the allowable

flow rate as specified above must be allowed. Exception: Showers that emit recirculated non potable water originating from within the shower compartment while operating are allowed to exceed the maximum as long as the total potable water flow does not exceed the flow rate as specified above.

The following fixtures, fittings and appliances are outside the scope of the water use reduction calculation:

- Commercial Steam Cookers
- Commercial Dishwashers
- Automatic Commercial Ice Makers
- Commercial (family sized) Clothes Washers
- Residential Clothes Washers
- Standard and Compact Residential Dishwashers

Potential Technologies & Strategies

Water Sense-certified fixtures and fixture fittings should be used where available. Use high-efficiency fixtures (e.g., water closets and urinals) and dry fixtures, such as toilets attached to composting systems, to reduce potable water demand. Consider using alternative on-site sources of water (e.g., rainwater, storm water, and air conditioner condensate) and gray water for non potable applications such as custodial uses and toilet and urinal flushing. The quality of any alternative source of water used must be taken into consideration based on its application or use.

Regulation GB-4.3: Energy & Atmosphere

4.3.1 EA Prerequisite 1: Fundamental Commissioning of Building Energy Systems

[EHS Mandatory]

Intent

Verify that the project's energy-related systems are installed, and calibrated to perform according to the owner's project requirements, basis of design and construction documents.

Benefits of commissioning include reduced energy use, lower operating costs, fewer contractor callbacks, better building documentation, improved occupant productivity and verification that the systems perform in accordance with the owner's project requirements.

Requirements

The following commissioning process activities must be completed by the project team:

- Designate an individual as the commissioning authority (CxA) to lead, review and oversee the completion of the commissioning process activities.
 - The CxA must have documented commissioning authority experience in at least 2 building projects.
 - The individual serving as the CxA must be independent of the project design and construction management, though the CxA may be an employee of any firm providing those services. The CxA may be a qualified employee or consultant of the owner.
 - The CxA must report results, findings and recommendations directly to the owner.
 - For projects smaller than 50,000 gross square feet, the CxA may be a qualified person on the design or construction team who has the required experience.
- The owner must document the owner's project requirements. The design team must develop the basis of design. The CxA must review these documents for clarity and completeness. The owner and design team must be responsible for updates to their respective documents.
- Develop and incorporate commissioning requirements into the construction documents.

- Develop and implement a commissioning plan.
- Verify the installation and performance of the systems to be commissioned.
- Complete a summary commissioning report.

Commissioned Systems

Commissioning process activities must be completed for the following energy-related systems, at a minimum:

- Heating, ventilating, air conditioning and refrigeration (HVAC&R) systems (mechanical and passive) and associated controls
- Lighting and day lighting controls
- Domestic hot water systems
- Renewable energy systems (e.g., wind, solar)

Potential Technologies & Strategies

Engage a CxA as early as possible in the design process. Determine the owner's project requirements, develop and maintain a commissioning plan for use during design and construction and incorporate commissioning requirements in bid documents. Assemble the commissioning team, and prior to occupancy verify the performance of energy consuming systems. Complete the commissioning reports with recommendations prior to accepting the commissioned systems.

Owners are encouraged to seek out qualified individuals to lead the commissioning process. Qualified individuals are identified as those who possess a high level of experience in the following areas:

- Energy systems design, installation and operation
- Commissioning planning and process management
- Hands-on field experience with energy systems performance, interaction, start-up, balancing, testing, troubleshooting, operation and maintenance procedures
- Energy systems automation control knowledge

Owners are encouraged to consider including water-using systems, building envelope systems, and other systems in the scope of the commissioning plan as appropriate. The building envelope is an

important component of a facility that impacts energy consumption, occupant comfort and indoor air quality. While this prerequisite does not require building envelope commissioning, an owner can achieve significant financial savings and reduce risk of poor indoor air quality by including it in the commissioning process.

The LEED Reference Guide for Green Building Design and Construction, 2009 Edition provides guidance on the rigor expected for this prerequisite for the following:

- Owner's project requirements
- Basis of design
- Commissioning plan
- Commissioning specification
- Performance verification documentation
- Commissioning report

4.3.2 EA Prerequisite 2: Minimum Energy Performance - Required – [EHS MANDATORY]

Intent

To establish the minimum level of energy efficiency for the proposed building and systems to reduce environmental and economic impacts associated with excessive energy use.

Requirements

OPTION 1. Whole Building Energy Simulation

Demonstrate a 10% improvement in the proposed building performance rating for new buildings, or a 5% improvement in the proposed building performance rating for major renovations to existing buildings, compared with the baseline building performance rating.

Calculate the baseline building performance rating according to the building performance rating method in Appendix G of ANSI/ASHRAE/IESNA Standard 90.1-2007 (with errata but without addenda*) using a computer simulation model for the whole building project.

Appendix G of Standard 90.1-2007 requires that the energy analysis done for the building performance

rating method include all energy costs associated with the building project. To achieve points using this credit, the proposed design must meet the following criteria:

- Comply with the mandatory provisions (Sections 5.4, 6.4, 7.4, 8.4, 9.4 and 10.4) in Standard 90.1-2007 (with errata but without addenda*).
- Include all energy costs associated with the building project.
- Compare against a baseline building that complies with Appendix G of Standard 90.1-2007 (with errata but without addenda*). The default process energy cost is 25% of the total energy cost for the baseline building. If the building's process energy cost is less than 25% of the baseline building energy cost, the LEED submittal must include documentation substantiating that process energy inputs are appropriate.

For the purpose of this analysis, process energy is considered to include, but is not limited to, office and general miscellaneous equipment, computers, elevators and escalators, kitchen cooking and refrigeration, laundry washing and drying, lighting exempt from the lighting power allowance (e.g., lighting integral to medical equipment) and other (e.g., waterfall pumps).

Regulated (non-process) energy includes lighting (for the interior, parking garage, surface parking, façade, or building grounds, etc. except as noted above), heating, ventilation and air conditioning (HVAC) (for space heating, space cooling, fans, pumps, toilet exhaust, Parking garage ventilation, kitchen hood exhaust, etc.), and service water heating for domestic or space heating purposes.

Process loads must be identical for both the baseline building performance rating and the proposed building performance rating. However, project teams may follow the exceptional calculation method (ANSI/ASHRAE/ IESNA Standard 90.1-2007 G2.5) to document measures that reduce process loads. Documentation of process load energy savings must include a list of the assumptions made for both the base and the proposed design, and theoretical or empirical information supporting these assumptions.

OR

OPTION 2. Prescriptive Compliance Path: ASHRAE Advanced Energy Design Guide

Comply with the prescriptive measures of the ASHRAE Advanced Energy Design Guide appropriate to the project scope, outlined below. Project teams must comply with all applicable criteria as established in the Advanced Energy Design Guide for the climate zone in which the building is located.

PAT H 1. ASHRAE Advanced Energy Design Guide for Small Office Buildings 2004

The building must meet the following requirements:

- Less than 20,000 square feet.
- Office occupancy.

PAT H 2. ASHRAE Advanced Energy Design Guide for Small Retail Buildings 2006

The building must meet the following requirements:

- Less than 20,000 square feet.
- Retail occupancy.

PAT H 3. ASHRAE Advanced Energy Design Guide for Small Warehouses and Self Storage Buildings 2008

The building must meet the following requirements:

- Less than 50,000 square feet.
- Warehouse or self-storage occupancy.

OR

OPTION 3. Prescriptive Compliance Path: Advanced Buildings™ Core Performance™ Guide

Comply with the prescriptive measures identified in the Advanced Buildings™ Core Performance™ Guide developed by the New Buildings Institute. The building must meet the following requirements:

- Less than 100,000 square feet.
- Office, school, public assembly, and retail projects less than 100,000 square feet must comply with Section 1 and Section 2 of the Core Performance Guide.
- Other project types less than 100,000 square feet implement the basic requirements of the Core Performance Guide.
- Health care, warehouse and laboratory projects are ineligible for this path.

Potential Technologies & Strategies

Design the building envelope and systems to meet baseline requirements. Use a computer simulation model to assess the energy performance and identify the most cost-effective energy efficiency

measures. Quantify energy performance compared with a baseline building.

4.3.3 EA Prerequisite 3: Fundamental Refrigerant Management - Required – [EHS MANDATORY]

Intent

To reduce stratospheric ozone depletion

Requirements

Zero use of chlorofluorocarbon (CFC)-based refrigerants in new base building heating, ventilating, air conditioning and refrigeration (HVAC&R) systems. When reusing existing base building HVAC equipment, complete a comprehensive CFC phase-out conversion prior to project completion. Phase-out plans extending beyond the project completion date will be considered on their merits.

Potential Technologies & Strategies

When reusing existing HVAC systems, conduct an inventory to identify equipment that uses CFC-based refrigerants and provide a replacement schedule for these refrigerants. For new buildings, specify new HVAC equipment in the base building that uses no CFC-based refrigerants.

4.3.4 EA Credit 1: Optimize Energy Performance - 1–19 Points [EHS MANDATORY(6 Points)]

Intent

To achieve increasing levels of energy performance beyond the prerequisite standard to reduce environmental and economic impacts associated with excessive energy use.

Requirements

Select 1 of the 3 compliance path options described below. Project teams documenting achievement using any of the 3 options are assumed to be in compliance with EA Prerequisite 2: Minimum Energy Performance.

OPTION 1. Whole Building Energy Simulation (1–19 points)

Demonstrate a percentage improvement in the proposed building performance rating compared with the baseline building performance rating. Calculate the baseline building performance according to Appendix G of ANSI/ASHRAE/IESNA Standard 90.1-2007

(with errata but without addenda1) using a computer simulation model for the whole building project.

The minimum energy cost savings percentage for each point threshold is as follows:

New Buildings	Existing Building Renovations	Points
12%	8%	1
14%	10%	2

16%	12%	3
18%	14%	4
20%	16%	5
22%	18%	6
24%	20%	7
26%	22%	8
28%	24%	9
30%	26%	10
32%	28%	11
34%	30%	12
36%	32%	13
38%	34%	14
40%	36%	15
42%	38%	16
44%	40%	17
46%	42%	18
48%	44%	19

Appendix G of Standard 90.1-2007 requires that the energy analysis done for the building performance rating method include all the energy costs associated with the building project. To achieve points under this credit, the proposed design must meet the following criteria:

- Compliance with the mandatory provisions (Sections 5.4, 6.4, 7.4, 8.4, 9.4 and 10.4) in Standard 90.1-2007 (with errata but without addenda).
- Inclusion of all the energy costs within and associated with the building project.
- Comparison against a baseline building that complies with Appendix G of Standard 90.1-2007 (with errata but without addenda). The default process energy cost is 25% of the total energy cost for the baseline building. If the building's process energy cost is less than 25% of the baseline building energy cost, the LEED submittal must include documentation substantiating that process energy inputs are appropriate.

For the purpose of this analysis, process energy is considered to include, but is not limited to, office and general miscellaneous equipment, computers, elevators and escalators, kitchen cooking and refrigeration, laundry, ashing and drying, lighting exempt from the lighting power allowance (e.g., lighting integral to medical equipment) and other (e.g., waterfall pumps).

Regulated (non-process) energy includes lighting (e.g., for the interior, parking garage, surface parking, façade, or building grounds, etc. except as noted above), heating, ventilating, and air conditioning (HVAC) (e.g., for space heating, space cooling, fans, pumps, toilet exhaust, parking garage ventilation, kitchen hood exhaust, etc.), and service water heating for domestic or space heating purposes.

For this credit, process loads must be identical for both the baseline building performance rating and

the proposed building performance rating. However, project teams may follow the exceptional calculation method (ANSI/ASHRAE/IESNA Standard 90.1-2007 G2.5) to document measures that reduce process loads. Documentation of process load energy savings must include a list of the assumptions made for both the base and proposed design, and theoretical or empirical information supporting these assumptions.

OR

OPTION 2. Prescriptive Compliance Path: ASHRAE Advanced Energy Design Guide (1 point)

Comply with the prescriptive measures of the ASHRAE Advanced Energy Design Guide appropriate to the project scope, outlined below. Project teams must comply with all applicable criteria as established in the Advanced Energy Design Guide for the climate zone in which the building is located.

PATH 1. ASHRAE Advanced Energy Design Guide for Small Office Buildings 2004

The building must meet the following requirements:

- Less than 20,000 square feet.
- Office occupancy.

PATH 2. ASHRAE Advanced Energy Design Guide for Small Retail Buildings 2006

The building must meet the following requirements:

- Less than 20,000 square feet.
- Retail occupancy.

PAT H 3. ASHRAE Advanced Energy Design Guide for Small Warehouses and Self Storage Buildings 2008

The building must meet the following requirements:

- Less than 50,000 square feet.
- Warehouse or self-storage occupancy.

OR

OPTION 3. Prescriptive Compliance Path: Advanced Buildings™ Core Performance™ Guide (1–3 points)

Comply with the prescriptive measures identified in the Advanced Buildings™ Core Performance™ Guide developed by the New Buildings Institute. The building must meet the following requirements

- Less than 100,000 square feet.
- Comply with Section 1: Design Process Strategies, and Section 2: Core Performance Requirements.
- Health care, warehouse or laboratory projects are ineligible for this path.

Points achieved under Option 3 (1 point):

- 1 point is available for all projects (office, school, public assembly, and retail projects) less than 100,000 square feet that comply with Sections 1 and 2 of the Core Performance Guide.
- Up to 2 additional points are available to projects that implement performance strategies listed in Section 3, Enhanced Performance. For every 3 strategies implemented from this section, 1 point is available.
- The following strategies are addressed by other aspects of LEED and are not eligible for additional points under EA Credit 1:
 - 3.1 — Cool Roofs
 - 3.8 — Night Venting
 - 3.13 — Additional Commissioning

Potential Technologies & Strategies

Design the building envelope and systems to maximize energy performance. Use a computer simulation model to assess the energy performance and identify the most cost-effective energy efficiency measures. Quantify energy performance compared with a baseline building.

If local code has demonstrated quantitative and textual equivalence following, at a minimum, the U.S. Department of Energy (DOE) standard process for commercial energy code determination, the results of that analysis may be used to correlate local code performance with ANSI/ASHRAE/IESNA Standard 90.1-2007.

4.3.5 EA Credit 2: On-site Renewable Energy - 1–7 Points

Intent

To encourage and recognize increasing levels of on-site renewable energy self-supply to reduce environmental and economic impacts associated with fossil fuel energy use.

Requirements

Use on-site renewable energy systems to offset building energy costs. Calculate project performance by expressing the energy produced by the renewable systems as a percentage of the building's annual energy cost and use the table below to determine the number of points achieved.

Use the building annual energy cost calculated in EA Credit 1: Optimize Energy Performance or the U.S. Department of Energy's Commercial Buildings Energy Consumption Survey database to determine the estimated electricity use.

The minimum renewable energy percentage for each point threshold is as follows:

Percentage Renewable Energy	Points
1%	1
3%	2
5%	3
7%	4
9%	5
11%	6
13%	7

Potential Technologies & Strategies

Assess the project for nonpolluting and renewable energy potential including solar, wind, geothermal, low-impact hydro, biomass and bio-gas strategies. When applying these strategies, take advantage of net metering with the local utility.

Note

Renewable energy is gaining global acceptance in view of the fact that it is clean and plays a significant role in reducing the Green House Gas (GHG) emissions from the built environment. Although this credit is non-mandatory, the use of Renewable technologies such as solar thermal, solar PV etc. is highly encouraged. The project team would endeavor to deploy suitable and genuine Renewable technologies as felt appropriate for the project.

4.3.6 EA Credit 3: Enhanced Commissioning - 2 Points– [EHS MANDATORY]

Intent

To begin the commissioning process early in the design process and execute additional activities after systems performance verification is completed.

Requirements

Implement, or have a contract in place to implement, the following additional commissioning process activities in addition to the requirements of EA Prerequisite 1: Fundamental Commissioning of Building Energy Systems and in accordance with the LEED Reference Guide for Green Building Design and Construction, 2009 Edition:

- Prior to the start of the construction documents phase, designate an independent commissioning authority (CxA) to lead, review and oversee the completion of all commissioning process activities.
- The CxA must have documented commissioning authority experience in at least 2 building projects.
- The individual serving as the CxA:

- Must be independent of the work of design and construction.
- Must not be an employee of the design firm, though he or she may be contracted through them.
- Must not be an employee of, or contracted through, a contractor or construction manager holding construction contracts.
- May be a qualified employee or consultant of the owner.
- The CxA must report results, findings and recommendations directly to the owner
- The CxA must conduct, at a minimum, 1 commissioning design review of the owner's project requirements basis of design, and design documents prior to the mid-construction documents phase and back-check the review comments in the subsequent design submission.
- The CxA must review contractor submittals applicable to systems being commissioned for compliance with the owner's project requirements and basis of design. This review must be concurrent with the review of the architect or engineer of record and submitted to the design team and the owner.
- The CxA or other project team members must develop a systems manual that gives future operating staff the information needed to understand and optimally operate the commissioned systems.
- The CxA or other project team members must verify that the requirements for training operating personnel and building occupants have been completed.
- The CxA must be involved in reviewing the operation of the building with operations and maintenance (O&M) staff and occupants within 10 months after substantial completion. A plan for resolving outstanding commissioning-related issues must be included.

Potential Technologies & Strategies

Although it is preferable that the CxA be contracted by the owner, for the enhanced commissioning credit the CxA may also be contracted through the design firms or construction management firms not holding construction contracts.

The LEED Reference Guide for Green Building Design and Construction, 2009 Edition provides detailed guidance on the rigor expected for the following process activities:

- Commissioning design review
- Commissioning submittal review
- Systems manual.

4.3.7 EA Credit 4: Enhanced Refrigerant Management - 2 Points– [EHS MANDATORY]

Intent

To reduce ozone depletion and support early compliance with the Montreal Protocol while minimizing direct contributions to climate change.

Requirements

OPTION 1

Do not use refrigerants.

OR

OPTION 2

Select refrigerants and heating, ventilation, air conditioning and refrigeration (HVAC&R) equipment that minimize or eliminate the emission of compounds that contribute to ozone depletion and climate change. The base building HVAC&R equipment must comply with the following formula, which sets a maximum threshold for the combined contributions to ozone depletion and global warming potential:

$$LCGWP + LCODP \times 10^5 \leq 100$$

Calculation definitions for $LCGWP + LCODP \times 10^5 \leq 100$

$$LCODP = [ODPr \times (Lr \times Life + Mr) \times Rc] / Life$$

$$LCGWP = [GWPr \times (Lr \times Life + Mr) \times Rc] / Life$$

LCODP: Lifecycle Ozone Depletion Potential (lb CFC 111T0n-Year)

LCGWP: Lifecycle Direct Global Warming Potential (lb CO₂1T0n-Year)

GWPr: Global Warming Potential of Refrigerant (0 to 12,000 lb CO/lbr)

ODPr: Ozone Depletion Potential of Refrigerant (0 to 0.2 lb CFC 11/1br)

Lr: Refrigerant Leakage Rate (0.5% to 2.0%; default of 2% unless otherwise)

Mr: End-of-life Refrigerant Loss (2% to 10%; default of 10% unless otherwise)

Rc: Refrigerant Charge (0.5 to 5.0 lbs of refrigerant per ton of gross ARI)

Life: Equipment Life (10 years; default based on equipment type, unless

For multiple types of equipment, a weighted average of all base building HVAC&R equipment must be calculated using the following formula:

$$\frac{\sum (LCGWP + LCODP \times 10^5) \times Q_{unit}}{Q_{total}} \leq 100$$

Calculation definitions for $[\sum (LCGWP + LCODP \times 10^5) \times Q_{unit}] / Q_{total} \leq 100$

Q_{unit} = Gross ARI rated cooling capacity of an individual HVAC or refrigeration unit (Tons)

Q_{total} = Total gross ARI rated cooling capacity of all HVAC or refrigeration

Small HVAC units (defined as containing less than 0.5 pounds of refrigerant) and other equipment, such as standard refrigerators, small water coolers and any other cooling equipment that contains less than 0.5 pounds of refrigerant, are not considered part of the base building system and are not subject to the requirements of this credit.

Do not operate or install fire suppression systems that contain ozone-depleting substances such as CFCs, hydrochlorofluorocarbons (HCFCs) or halons.

Potential Technologies & Strategies

Design and operate the facility without mechanical cooling and refrigeration equipment. Where mechanical cooling is used, utilize base building HVAC&R systems for the refrigeration cycle that minimizes direct impact on ozone depletion and global climate change. Select HVAC&R equipment with reduced refrigerant charge and increased equipment life. Maintain equipment to prevent leakage of refrigerant to the atmosphere. Use fire suppression systems that do not contain HCFCs or halons.

4.3.8 EA Credit 5: Measurement and Verification - 3 Points– [EHS MANDATORY]

Intent

To provide for the ongoing accountability of building energy consumption over time.

Requirements

OPTION 1

Develop and implement a measurement and verification (M&V) plan consistent with Option D: Calibrated Simulation (Savings Estimation Method 2) as specified in the International Performance Measurement & Verification Protocol (IPMVP) Volume III: Concepts and Options for Determining Energy Savings in New Construction, April 2003.

The M&V period must cover at least 1 year of post-construction occupancy. Provide a process for corrective action if the results of the M&V plan indicate that energy savings are not being achieved.

OR

OPTION 2

Develop and implement a measurement and verification (M&V) plan consistent with Option B: Energy Conservation Measure Isolation, as specified in the International Performance Measurement & Verification Protocol (IPMVP) Volume III: Concepts and Options for Determining Energy Savings in New Construction, April 2003.

The M&V period must cover at least 1 year of post-construction occupancy.

Provide a process for corrective action if the results of the M&V plan indicate that energy savings are not being achieved.

Potential Technologies & Strategies

Develop an M&V plan to evaluate building and/or energy system performance. Characterize the building and/or energy systems through energy simulation or engineering analysis. Install the necessary metering equipment to measure energy use.

Track performance by comparing predicted performance to actual performance, broken down by component or system as appropriate. Evaluate energy efficiency by comparing actual performance to baseline performance.

While the IPMVP describes specific actions for verifying savings associated with energy conservation measures (ECMs) and strategies, this LEED credit expands upon typical IPMVP M&V objectives. Measurement & verification activities should not necessarily be confined to energy systems where ECMs or energy conservation strategies have been implemented. The IPMVP provides guidance on M&V strategies and their appropriate applications for various situations. These strategies should be used in conjunction with monitoring and trend logging of significant energy systems to provide for the ongoing accountability of building energy performance.

For the corrective action process, consider installing diagnostics within the control system to alert the staff when equipment is not being optimally operated. Conditions that might warrant alarms to alert staff could include:

- Leaking valves in the cooling and heating coils within air handling units;
- Missed economizer opportunities (e.g., faulty economizer damper controls) ;
- Software and manual overrides allowing equipment to operate 24 hours a day/7 days a week;
- Equipment operation during unusual circumstances (e.g., boiler on when outside air temperature is above 65 °F).

Besides control diagnostics, consider employing retro-commissioning services or dedicating staff to investigate increases in energy usage (such a staff member is usually a resource conservation manager — see <http://www.energy.state.or.us/rcm/rcmhm.htm> for additional information).

4.3.9 EA Credit 6: Green Power - 2 Points

Intent

To encourage the development and use of grid-source, renewable energy technologies on a net zero pollution basis.

Requirements

Engage in at least a 2-year renewable energy contract to provide at least 35% of the building's electricity from renewable sources, as defined by the Center for Resource Solutions' Green-e Energy product certification requirements.

All purchases of green power shall be based on the quantity of energy consumed, not the cost.

OPTION 1. Determine Baseline Electricity Use

Use the annual electricity consumption from the results of EA Credit 1: Optimize Energy Performance.

OR

OPTION 2. Estimate Baseline Electricity Use

Use the U.S. Department of Energy's Commercial Buildings Energy Consumption Survey database to determine the estimated electricity use.

Potential Technologies & Strategies

Determine the energy needs of the building and investigate opportunities to engage in a green power contract. Green power is derived from solar, wind, geothermal, biomass or low-impact hydro sources.

Visit <http://www.green-e.org/energy> for details about the Green-e Energy program. The green power product purchased to comply with credit requirements need not be Green-e Energy certified. Other sources of green power are eligible if they satisfy the Green-e Energy program's technical requirements. Renewable energy certificates (RECs), tradable renewable certificates (TRCs), green tags and other forms of green power that comply with the technical requirements of the Green-e Energy program may be used to document compliance with this credit.

Regulation GB-4.4: Materials & Resources

4.4.1 MR Prerequisite 1: Storage and Collection of Recyclables Required –[EHS Mandatory]

Intent

To facilitate the reduction of waste generated by building occupants that is hauled to and disposed of in landfills.

Requirements

Provide an easily-accessible dedicated area or areas for the collection and storage of materials for recycling for the entire building. Materials must include, at a minimum: paper, corrugated cardboard, glass, plastics and metals.

Potential Technologies & Strategies

Designate an area for recyclable collection and storage that is appropriately sized and located in a convenient area. Identify local waste handlers and buyers for glass, plastic, metals, office paper, newspaper, cardboard and organic wastes. Instruct occupants on recycling procedures. Consider employing cardboard balers, aluminum can crushers, recycling chutes and other waste management strategies to further enhance the recycling program.

4.4.2 MR Credit 1.1: Building Reuse—Maintain Existing Walls, Floors and Roof [1 – 3 points]

Intent

To extend the lifecycle of existing building stock, conserve resources, retain cultural resources, reduce waste and reduce environmental impacts of new buildings as they relate to materials manufacturing and transport.

Requirements

Maintain the existing building structure (including structural floor and roof decking) and envelope (the exterior skin and framing, excluding window assemblies and non-structural roofing material). The minimum percentage building reuse for each point threshold is as follows:

Building Reuse	Points
55%	1
75%	2
95%	3

Hazardous materials that are remediate as a part of the project must be excluded from the calculation of the percentage maintained. If the project includes an addition that is more than 2 times the square footage of the existing building, this credit is not applicable.

Potential Technologies & Strategies

Consider reusing existing, previously-occupied building structures, envelopes and elements. Remove elements that pose a contamination risk to building occupants and upgrade components that would improve energy and water efficiency such as windows, mechanical systems and plumbing fixtures.

4.4.3 MR Credit 1.2: Building Reuse—Maintain Interior Nonstructural Elements [1 point]

Intent

To extend the lifecycle of existing building stock, conserve resources, retain cultural resources, reduce waste and reduce environmental impacts of new buildings as they relate to materials manufacturing and transport.

Requirements

Use existing interior nonstructural elements (e.g., interior walls, doors, floor coverings and ceiling systems) in at least 50% (by area) of the completed building, including additions. If the project includes an addition with square footage more than 2 times the square footage of the existing building, this credit is not applicable.

Potential Technologies & Strategies

Consider reusing existing building structures, envelopes and interior nonstructural elements. Remove elements that pose a contamination risk to building occupants, and upgrade components that would improve energy and water efficiency such as mechanical systems and plumbing fixtures. Quantify the extent of building reuse.

4.4.4 MR Credit 2: Construction Waste Management - 1–2 Points [EHS Mandatory(1 point)]

Intent

To divert construction and demolition debris from disposal in landfills and incineration facilities. Redirect recyclable recovered resources back to the manufacturing process and reusable materials to appropriate sites.

Requirements

Recycle and/or salvage non-hazardous construction and demolition debris. Develop and implement a construction waste management plan that, at a minimum, identifies the materials to be diverted from disposal and whether the materials will be sorted on-site or comingled. Excavated soil and land-clearing debris do not contribute to this credit.

Calculations can be done by weight or volume, but must be consistent throughout. The minimum percentage debris to be recycled or salvaged for each point threshold is as follows:

Recycled or	Points
50%	1
75%	2

Potential Technologies & Strategies

Establish goals for diversion from disposal in landfills and incineration facilities and adopt a construction waste management plan to achieve these goals. Consider recycling cardboard, metal, brick, mineral fiber panel, concrete, plastic, clean wood, glass, gypsum wallboard, carpet and insulation. Construction debris processed into a recycled content commodity that has an open market value (e.g., wood derived fuel [WDF], alternative daily cover material, etc.) may be applied to the construction waste calculation. Designate a specific area(s) on the construction site for segregated or comingled collection of recyclable materials, and track recycling efforts throughout the construction process. Identify construction haulers and recyclers to handle the designated materials. Note that diversion may include donation of materials to charitable organizations and salvage of materials on-site.

4.4.5 MR Credit 3: Materials Reuse - 1–2 Points

Intent

To reuse building materials and products to reduce demand for virgin materials and reduce waste, thereby lessening impacts associated with the extraction and processing of virgin resources.

Requirements

Use salvaged, refurbished or reused materials, the sum of which constitutes at least 5% or 10%, based on cost, of the total value of materials on the project. The minimum percentage materials reused for each point threshold is as follows:

Reused	Points
5%	1
10%	2

Mechanical, electrical and plumbing components and specialty items such as elevators and equipment cannot be included in this calculation. Include only materials permanently installed in the project. Furniture may be included if it is included consistently in MR Credit 3: Materials Reuse through MR Credit 7: Certified Wood.

Potential Technologies & Strategies

Identify opportunities to incorporate salvaged materials into the building design, and research potential material suppliers. Consider salvaged materials such as beams and posts, flooring, paneling, doors and frames, cabinetry and furniture, brick, and decorative items.

4.4.6 MR Credit 4: Recycled Content - 1–2 Points [EHS Mandatory(1 point)]

Intent

To increase demand for building products that incorporate recycled content materials, thereby reducing impacts resulting from extraction and processing of virgin materials.

Requirements

Use materials with recycled content¹ such that the sum of postconsumer² recycled content plus 1/2 of the preconsumer³ content constitutes at least 10% or 20%, based on cost, of the total value of the materials in the project. The minimum percentage materials recycled for each point threshold is as follows:

Recycled	Points
10%	1
20%	2

The recycled content value of a material assembly is determined by weight. The recycled fraction of the assembly is then multiplied by the cost of assembly to determine the recycled content value. Mechanical, electrical and plumbing components and specialty items such as elevators cannot be included in this calculation. Include only materials permanently installed in the project. Furniture may be included if it is included consistently in MR Credit 3: Materials Reuse through MR Credit 7: Certified Wood.

Potential Technologies & Strategies

Establish a project goal for recycled content materials, and identify material suppliers that can achieve this goal. During construction, ensure that the specified recycled content materials are installed. Consider a range of environmental, economic and performance attributes when selecting products and materials.

1-Recycled content is defined in accordance with the International Organization of Standards document, ISO 14021 - Environmental labels and declarations Self-declared environmental claims (Type II environmental labeling) .

2- Post consumer material is defined as waste material generated by households or by commercial, industrial and institutional facilities in their role as end-users of the product, which can no longer be used for its intended purpose.

3-Preconsumer material is defined as material diverted from the waste stream during the manufacturing process. Reutilization of materials (i.e., rework, regrind or scrap generated in a process and capable of being reclaimed within the same process that generated it) is excluded.

4.4.7 MR Credit 5: Regional Materials - 1-2 Points

Intent

To increase demand for building materials and products that are extracted and manufactured within the region, thereby supporting the use of indigenous resources and reducing the environmental impacts resulting from transportation.

Requirements

Use building materials or products that have been extracted, harvested or recovered, as well as manufactured, within 500 miles of the project site for a minimum of 10% or 20%, based on cost, of the total materials value. If only a fraction of a product or material is extracted, harvested, or recovered and manufactured locally, then only that percentage (by weight) can contribute to the regional value. The minimum percentage regional materials for each point threshold are as follows:

Regional	Points
10%	1
20%	2

Mechanical, electrical and plumbing components and specialty items such as elevators and equipment must not be included in this calculation. Include only materials permanently installed in the project. Furniture may be included if it is included consistently in MR Credit 3: Materials Reuse through MR Credit 7: Certified Wood.

Potential Technologies & Strategies

Establish a project goal for locally sourced materials, and identify materials and material suppliers that can achieve this goal. During construction, ensure that the specified local materials are installed, and quantify the total percentage of local materials installed. Consider a range of environmental, economic and performance attributes when selecting products and materials.

4.4.8 MR Credit 6: Rapidly Renewable Materials – [1 point]

Intent

To reduce the use and depletion of finite raw materials and long-cycle renewable materials by replacing them with rapidly renewable materials.

Requirements

Use rapidly renewable building materials and products for 2.5% of the total value of all building materials and products used in the project, based on cost. Rapidly renewable building materials and products are made from plants that are typically harvested within a 10-year or shorter cycle.

Potential Technologies & Strategies

Establish a project goal for rapidly renewable materials, and identify products and suppliers that can support achievement of this goal. Consider materials such as bamboo, wool, cotton insulation, agrifiber, linoleum, wheat board, strawboard and cork. During construction, ensure that the specified renewable materials are installed.

4.4.9 MR Credit 7: Certified Wood – [1 point]

Intent

To encourage environmentally responsible forest management.

Requirements

Use a minimum of 50% (based on cost) of wood-based materials and products that are certified in accordance with the Forest Stewardship Council's principles and criteria, for wood building components. These components include at a minimum, structural framing and general dimensional framing, flooring, sub-flooring, wood doors and finishes.

Include only materials permanently installed in the project. Wood products purchased for temporary use on the project (e.g., formwork, bracing, scaffolding, sidewalk protection, and guard rails) may be included in the calculation at the project team's discretion. If any such materials are included, all such materials must be included in the calculation. If such materials are purchased for use on multiple projects, the applicant may include these materials for only one project, at its discretion. Furniture may be included if it is included consistently in MR Credits 3, Materials Reuse, through MR Credit 7, Certified Wood.

Potential Technologies & Strategies

Establish a project goal for FSC-certified wood products and identify suppliers that can achieve this goal. During construction, ensure that the FSC-certified wood products are installed and quantify the total percentage of FSC-certified wood products installed.

Regulation GB-4.5: Indoor Environmental Quality

4.5.1 Prerequisite 1: Minimum Indoor Air Quality Performance - Required –[EHS Mandatory]

Intent

To establish minimum indoor air quality (IAQ) performance to enhance indoor air quality in buildings, thus contributing to the comfort and well-being of the occupants.

Requirements

CASE 1. Mechanically Ventilated Spaces

Meet the minimum requirements of Sections 4 through 7 of ASHRAE Standard 62.1-2007, Ventilation for Acceptable Indoor Air Quality (with errata but without addenda1). Mechanical ventilation systems must be designed using the ventilation rate procedure or the applicable local code, whichever is more stringent.

CASE 2. Naturally Ventilated Spaces

Naturally ventilated buildings must comply with ASHRAE Standard 62.1-2007, Paragraph 5.1 (with errata but without addenda1).

Potential Technologies & Strategies

Design ventilation systems to meet or exceed the minimum outdoor air ventilation rates as described in the ASHRAE standard. Balance the impacts of ventilation rates on energy use and indoor air quality to optimize for energy efficiency and occupant comfort. Use the ASHRAE Standard 62.1-2007 Users Manual (with errata but without addenda1) for detailed guidance on meeting the referenced requirements.

4.5.2 Prerequisite 2: Environmental Tobacco Smoke (ETS) Control - Required – [EHS Mandatory]

Intent

To prevent or minimize exposure of building occupants, indoor surfaces and ventilation air distribution systems to environmental tobacco smoke (ETS).

Requirements

CASE 1. All Projects

OPTION 1

Prohibit smoking in the building.

Prohibit on-property smoking within 25 feet of entries, outdoor air intakes and operable windows.

Provide signage to allow smoking in designated areas, prohibit smoking in designated areas or prohibit smoking on the entire property.

OR

OPTION 2

Prohibit smoking in the building except in designated smoking areas.

Prohibit on-property smoking within 25 feet of entries, outdoor air intakes and operable windows. Provide signage to allow smoking in designated areas, prohibit smoking in designated areas or prohibit smoking on the entire property.

Provide designated smoking rooms designed to contain, capture and remove ETS from the building. At a minimum, the smoking room must be directly exhausted to the outdoors, away from air intakes and building entry paths, with no recirculation of ETS-containing air to nonsmoking areas and enclosed with impermeable deck-to-deck partitions. Operate exhaust sufficient to create a negative pressure differential with the surrounding spaces of at least an average of 5 Pascals (Pa) (0.02 inches of water gauge) and a minimum of 1 Pa (0.004 inches of water gauge) when the doors to the smoking rooms are closed.

Verify performance of the smoking rooms' differential air pressures by conducting 15 minutes of measurement, with a minimum of 1 measurement every 10 seconds, of the differential pressure in the smoking room with respect to each adjacent area and in each adjacent vertical chase with the doors to the smoking room closed. Conduct the testing with each space configured for worst-case conditions of transport of air from the smoking rooms (with closed doors) to adjacent spaces.

CASE 2. Residential and Hospitality Projects Only

Prohibit smoking in all common areas of the building.

Locate any exterior designated smoking areas, including balconies where smoking is permitted, at least 25 feet from entries, outdoor air intakes and operable windows opening to common areas.

Prohibit on-property smoking within 25 feet of entries, outdoor air intakes and operable windows. Provide signage to allow smoking in designated areas, prohibit smoking in designated areas or prohibit smoking on the entire property.

Weather-strip all exterior doors and operable windows in the residential units to minimize leakage from outdoors.

Minimize uncontrolled pathways for ETS transfer between individual residential units by sealing penetrations in walls, ceilings and floors in the residential units and by sealing vertical chases adjacent to the units.

Weather-strip all doors in the residential units leading to common hallways to minimize air leakage into the hallway1.

Demonstrate acceptable sealing of residential units by a blower door test conducted in accordance with ANSI/ASTM-E779-03, Standard Test Method for Determining Air Leakage Rate By Fan Pressurization.

Use the progressive sampling methodology defined in Chapter 4 (Compliance Through Quality Construction) of the Residential Manual for Compliance with California's 2001 Energy Efficiency Standards (http://www.energy.ca.gov/title24/residential_manual). Residential units must demonstrate less than 1.25 square inches leakage area per 100 square feet of enclosure area (i.e., sum of all wall, ceiling and floor areas).

Potential Technologies & Strategies

Prohibit smoking in commercial buildings or effectively control the ventilation air in smoking rooms. For residential buildings, prohibit smoking in common areas and design building envelope and systems to minimize ETS transfer among dwelling units.

4.5.3 Credit 1: Outdoor Air Delivery Monitoring - 1 Point [EHS Mandatory]

Intent

To provide capacity for ventilation system monitoring to help promote occupant comfort and well-being.

Requirements

Install permanent monitoring systems to ensure that ventilation systems maintain design minimum requirements. Configure all monitoring equipment to generate an alarm when airflow values or carbon dioxide (CO2) levels vary by 10% or more from the design values via either a building automation system alarm to the building operator or a visual or audible alert to the building occupants

AND

CASE 1. Mechanically Ventilated Spaces

Monitor CO2 concentrations within all densely occupied spaces (those with a design occupant density of 25 people or more per 1,000 square feet). CO2 monitors must be between 3 and 6 feet above the floor.

Provide a direct outdoor airflow measurement device capable of measuring the minimum outdoor air intake flow with an accuracy of plus or minus 15% of the design minimum outdoor air rate, as defined by ASHRAE Standard 62.1-2007 (with errata but without addenda*) for mechanical

ventilation systems where 20% or more of the design supply airflow serves no densely occupied spaces.

CASE 2. Naturally Ventilated Spaces

Monitor CO2 concentrations within all naturally ventilated spaces. CO2 monitors must be between 3 and 6 feet above the floor. One CO2 sensor may be used to monitor multiple nondensely occupied spaces if the natural ventilation design uses passive stack(s) or other means to induce airflow through those spaces equally and simultaneously without intervention by building occupants*.

Potential Technologies & Strategies

Install CO2 and airflow measurement equipment and feed the information to the heating, ventilating and air conditioning (HVAC) system and/or building automation system (BAS) to trigger corrective action, if applicable. If such automatic controls are not feasible with the building systems, use the measurement equipment to trigger alarms that inform building operators or occupants of a possible deficiency in outdoor air delivery.

4.5.4 Credit 2: Increased Ventilation –[1 point]

Intent

To provide additional outdoor air ventilation to improve indoor air quality (IAQ) and promote occupant comfort, well-being and productivity.

Requirements

CASE 1. Mechanically Ventilated Spaces

Increase breathing zone outdoor air ventilation rates to all occupied spaces by at least 30% above the minimum rates required by ASHRAE Standard 62.1-2007 (with errata but without addenda1) as determined by IEQ Prerequisite 1: Minimum Indoor Air Quality Performance.

CASE 2. Naturally Ventilated Spaces

Design natural ventilation systems for occupied spaces to meet the recommendations set forth in the Carbon Trust Good Practice Guide 237 (1998). Determine that natural ventilation is an effective strategy for the project by following the flow diagram process shown in Figure 1.18 of the Chartered Institution of Building Services Engineers (CIBSE) Applications Manual 10: 2005, Natural Ventilation in Non-domestic Buildings.

AND

OPTION 1

Use diagrams and calculations to show that the design of the natural ventilation systems meets the recommendations set forth in the CIBSE Applications Manual 10: 2005, Natural Ventilation in Non-domestic Buildings.

OR

OPTION 2

Use a macroscopic, multizone, analytic model to predict that room-by-room airflows will effectively naturally ventilate, defined as providing the minimum ventilation rates required by ASHRAE 62.1-2007 Chapter 6 (with errata but without addenda), for at least 90% of occupied spaces.

Potential Technologies & Strategies

For mechanically ventilated spaces: Use heat recovery, where appropriate, to minimize the additional energy consumption associated with higher ventilation rates.

For naturally ventilated spaces: Follow the 8 design steps described in the Carbon Trust Good Practice Guide 237:

- Develop design requirements.
- Plan airflow paths.
- Identify building uses and features that might require special attention.
- Determine ventilation requirements.
- Estimate external driving pressures.
- Select types of ventilation devices.
- Size ventilation devices.
- Analyze the design.

Use public domain software such as NIST's CONTAM, Multizone Modeling Software, along with Loop DA, Natural Ventilation Sizing Tool, to analytically predict room-by-room airflows.

4.5.5 Credit3.1: Construction Indoor Air Quality Management Plan—During Construction - 1 Point [EHS Mandatory]

Intent

To reduce indoor air quality (IAQ) problems resulting from construction or renovation and promote the comfort and well-being of construction workers and building occupants.

Requirements

Develop and implement an IAQ management plan for the construction and preoccupancy phases of the building as follows:

- During construction, meet or exceed the recommended control measures of the Sheet Metal and Air Conditioning National Contractors Association (SMACNA) IAQ Guidelines for Occupied Buildings under Construction, 2nd Edition 2007, ANSI/SMACNA 008-2008 (Chapter 3).

- Protect stored on-site and installed absorptive materials from moisture damage.
- If permanently installed air handlers are used during construction, filtration media with a minimum efficiency reporting value (MERV) of 8 must be used at each return air grille, as determined by ASHRAE Standard 52.2-1999 (with errata but without addenda1). Replace all filtration media immediately prior to occupancy.

Potential Technologies & Strategies

Adopt an IAQ management plan to protect the heating, ventilating and air conditioning (HVAC) system during construction, control pollutant sources and interrupt contamination pathways. Sequence the installation of materials to avoid contamination of absorptive materials, such as insulation, carpeting, ceiling tile and gypsum wallboard. Coordinate with IEQ Credit 3.2: Construction IAQ Management Plan — Before Occupancy and IEQ Credit 5: Indoor Chemical & Pollutant Source Control to determine the appropriate specifications and schedules for filtration media.

If possible, avoid using permanently installed air handlers for temporary heating/cooling during construction. Consult the LEED Reference Guide for Green Building Design and Construction, 2009 Edition for more detailed information on how to ensure the well-being of construction workers and building occupants if permanently installed air handlers must be used during construction.

4.5.6 Credit 3.2: Construction Indoor Air Quality Management Plan—Before Occupancy -1 Point [EHS Mandatory]

Intent

To reduce indoor air quality (IAQ) problems resulting from construction or renovation to promote the comfort and well-being of construction workers and building occupants.

Requirements

Develop an IAQ management plan and implement it after all finishes have been installed and the building has been completely cleaned before occupancy.

OPTION 1. Flush-Out1

PAT H 1

After construction ends, prior to occupancy and with all interior finishes installed, install new filtration media and , perform a building flush-out by supplying a total air volume of 14,000 cubic feet of outdoor air per square foot of floor area while maintaining an internal temperature of at least 60° F and relative humidity no higher than 60%.

OR

PAT H 2

If occupancy is desired prior to completion of the flush-out, the space may be occupied following delivery of a minimum of 3,500 cubic feet of outdoor air per square foot floor area. Once the space is occupied, it must be ventilated at a minimum rate of 0.30 cubic feet per minute (cfm) per square foot of outside air or the design minimum outside air rate determined in IEQ Prerequisite 1: Minimum Indoor Air Quality Performance, whichever is greater. During each day of the flush-out period, ventilation must begin a minimum of 3 hours prior to occupancy and continue during occupancy. These conditions must be maintained until a total of 14,000 cubic feet per square foot of outside air has been delivered to the space.

OR

OPTION 2. Air Testing

Conduct baseline IAQ testing after construction ends and prior to occupancy using testing protocols consistent with the EPA Compendium of Methods for the Determination of Air Pollutants in Indoor Air and as additionally detailed in the LEED Reference Guide for Green Building Design and Construction, 2009 Edition.

Demonstrate that the contaminant maximum concentration levels listed below are not exceeded:

Contaminant	Maximum Concentration
Formaldehyde	27 parts per billion
Particulates (PM10)	50 micrograms per cubic meter
Total volatile organic	500 micrograms per cubic meter
4-Phenylcyclohexene (4-CH)*	6.5 micrograms per cubic meter
Carbon monoxide (CO)	9 part per million and no greater than 2 parts per million
* This test is only required if carpets and fabrics with styrene butadiene rubber (SBR) latex backing are installed as part of the base building systems.	

For each sampling point where the maximum concentration limits are exceeded, conduct an additional flush out with outside air and retest the noncompliant concentrations. Repeat until all requirements are met. When retesting noncompliant building areas, take samples from the same locations as in the first test, although it is not required.

Conduct the air sample testing as follows:

- All measurements must be conducted prior to occupancy, but during normal occupied hours with the building ventilation system started at the normal daily start time and operated at the minimum outside air flow rate for the occupied mode throughout the test.

- All interior finishes must be installed, including but not limited to millwork, doors, paint, carpet and acoustic tiles. Movable furnishings such as workstations and partitions should be in place for the testing, although it is not required.
- The number of sampling locations will depend on the size of the building and number of ventilation systems. For each portion of the building served by a separate ventilation system, the number of sampling points must not be less than 1 per 25,000 square feet or for each contiguous floor area, whichever is larger. Include areas with the least ventilation and greatest presumed source strength.
- Air samples must be collected between 3 and 6 feet from the floor to represent the breathing zone of occupants, and over a minimum 4-hour period.

Potential Technologies & Strategies

Prior to occupancy, perform a building flush-out or test the air contaminant levels in the building. The flush-out is often used where occupancy is not required immediately upon substantial completion of construction. IAQ testing can minimize schedule impacts but may be more costly. Coordinate with IEQ Credit 3.1: Construction IAQ Management Plan — During Construction and IEQ Credit 5: Indoor Chemical & Pollutant Source Control to determine the appropriate specifications and schedules for filtration media.

The intent of this credit is to eliminate IAQ problems that occur as a result of construction. Architectural finishes used in tenant build-outs constitute a significant source of air pollutants and must be addressed to qualify for this credit.

4.5.7 Credit 4.1: Low-Emitting Materials—Adhesives and Sealants - 1 Point [EHS Mandatory]

Intent

To reduce the quantity of indoor air contaminants those are odorous, irritating and/or harmful to the comfort and well-being of installers and occupants.

Requirements

All adhesives and sealants used on the interior of the building (i.e., inside of the weatherproofing system and applied on-site) must comply with the following requirements as applicable to the project scope*:

- Adhesives, Sealants and Sealant Primers must comply with South Coast Air Quality Management District (SCAQMD) Rule #1168. Volatile organic compound (VOC) limits listed in the table below correspond to an effective date of July 1, 2005 and rule amendment date of January 7, 2005.

Architectural Applications	VOC Limit (g/L less water)	Specialty Applications	VOC Limit (g/L less water)
Indoor carpet adhesives	50	PVC welding	510
Carpet pad adhesives	50	CPVC welding	490
Wood flooring adhesives	100	ABS welding	325
Rubber floor adhesives	60	Plastic cement welding	250
Sub floor adhesives	50	Adhesive primer for plastic	550
Ceramic tile adhesives	65	Contact adhesive	80
VCT and asphalt adhesives	50	Special purpose contact	250
Drywall and panel adhesives	50	Structural wood member	140
Cove base adhesives	50	Sheet applied rubber lining	850
Multi purpose construction	70	Top and trim adhesive	250
Structural glazing adhesives	100		
Substrate Specific Applications	VOC Limit (g/L less water)	Sealants	VOC Limit (g/L less water)
Metal to metal	30	Architectural	250
Plastic foams	50	No membrane roof	300
Porous material (except wood)	50	Roadway	250
Wood	30	Single-ply roof membrane	450
Fiberglass	80	Other	420
Sealant Primers	VOC Limit (g/L less water)		
Architectural, nonporous	250		
Architectural, porous	775		
Other	750		

- Aerosol Adhesives must comply with Green Seal Standard for Commercial Adhesives GS-36 requirements in effect on October 19, 2000.

Aerosol Adhesives	VOC Limit
General purpose mist spray	65% VOCs by weight
General purpose web spray	55% VOCs by weight
Special purpose aerosol adhesives	70% VOCs by weight

Potential Technologies & Strategies

Specify low-VOC materials in construction documents. Ensure that VOC limits are clearly stated in each section of the specifications where adhesives and sealants are addressed. Common products to evaluate include general construction adhesives, flooring adhesives, fire-stopping sealants, caulking, duct sealants, plumbing adhesives and cove base adhesives. Review product cut sheets, material safety data (MSD) sheets, signed attestations or other official literature from the

manufacturer clearly identifying the VOC contents or compliance with referenced standards.

4.5.8 IEQ Credit 4.2: Low-Emitting Materials—Paints and Coatings –[1 point]

Intent

To reduce the quantity of indoor air contaminants those are odorous, irritating and/or harmful to the comfort and well-being of installers and occupants.

Requirements

Paints and coatings used on the interior of the building (i.e., inside of the weatherproofing system and applied onsite) must comply with the following criteria as applicable to the project scope*:

- Architectural paints and coatings applied to interior walls and ceilings must not exceed the volatile organic compound (VOC) content limits established in Green Seal Standard GS-11, Paints, 1st Edition, and May 20, 1993.
- Anti-corrosive and anti-rust paints applied to interior ferrous metal substrates must not exceed the VOC content limit of 250 g/L established in Green Seal Standard GC-03, Anti-Corrosive Paints, 2nd Edition, and January 7, 1997.
- Clear wood finishes, floor coatings, stains, primers, and shellacs applied to interior elements must* not exceed the VOC content limits established in South Coast Air Quality Management District (SCAQMD) Rule 1113, Architectural Coatings, rules in effect on January 1, 2004.

Potential Technologies & Strategies

Specify low-VOC paints and coatings in construction documents. Ensure that VOC limits are clearly stated in each section of the specifications where paints and coatings are addressed. Track the VOC content of all interior paints and coatings during construction.

4.5.9 IEQ Credit 4.3: Low-Emitting Materials—Flooring Systems – [1 point]

Intent

To reduce the quantity of indoor air contaminants that are odorous, irritating and/or harmful to the comfort and well-being of installers and occupants.

Requirements

OPTION 1

All flooring must comply with the following as applicable to the project scope:

- All carpet installed in the building interior must meet the testing and product requirements of the Carpet and Rug Institute Green Label Plus1 program.

- All carpet cushion installed in the building interior must meet the requirements of the Carpet and Rug Institute Green Label program.
- All carpet adhesive must meet the requirements of IEQ Credit 4.1: Adhesives and Sealants, which includes a volatile organic compound (VOC) limit of 50 g/L.
- All hard surface flooring must be certified as compliant with the FloorScore2 standard (current as of the date of this rating system, or more stringent version) by an independent third-party. Flooring products covered by Floor Score include vinyl, linoleum, laminate flooring, wood flooring, ceramic flooring, rubber flooring and wall base.
- An alternative compliance path using Floor Score is acceptable for credit achievement: 100% of the non-carpet finished flooring must be Floor Score-certified and must constitute at least 25% of the finished floor area. Examples of unfinished flooring include floors in mechanical rooms, electrical rooms and elevator service rooms.
- Concrete, wood, bamboo and cork floor finishes such as sealer, stain and finish must meet the requirements of South Coast Air Quality Management District (SCAQMD) Rule 1113, Architectural Coatings, rules in effect on January 1, 2004.
- Tile setting adhesives and grout must meet South Coast Air Quality Management District (SCAQMD) Rule 1168. VOC limits correspond to an effective date of July 1, 2005 and rule amendment date of January 7, 2005.

OR

OPTION 2

All flooring elements installed in the building interior must meet the testing and product requirements of the California Department of Health Services Standard Practice for the Testing of Volatile Organic Emissions from Various Sources Using Small-Scale Environmental Chambers, including 2004 Addenda.

Potential Technologies & Strategies

Clearly specify requirements for product testing and/or certification in the construction documents. Select products that are either certified under the Green Label Plus program or for which testing has been done by qualified independent laboratories in accordance with the appropriate requirements.

4.5.10 IEQ Credit 4.4: Low-Emitting Materials—Composite Wood and Agrifiber Products – [1 point]

Intent

To reduce the quantity of indoor air contaminants that are odorous, irritating and/or harmful to the comfort and well-being of installers and occupants.

Requirements

Composite wood and agrifiber products used on the interior of the building (i.e., inside the weatherproofing system) must contain no added urea-formaldehyde resins. Laminating adhesives used to fabricate on-site and shop-applied composite wood and agrifiber assemblies must not contain added urea-formaldehyde resins.

Composite wood and agrifiber products are defined as particleboard, medium density fiberboard (MDF), plywood, wheat board, strawboard, panel substrates and door cores. Materials considered fixtures, furniture and equipment (FF&E) are not considered base building elements and are not included.

Potential Technologies & Strategies

Specify wood and agrifiber products that contain no added urea-formaldehyde resins. Specify laminating adhesives for field and shop-applied assemblies that contain no added urea-formaldehyde resins. Review product cut sheets, material safety data (MSD) sheets, signed attestations or other official literature from the manufacturer.

4.5.11 IEQ Credit 5: Indoor Chemical and Pollutant Source Control1 Point [EHS Mandatory]

Intent

To minimize building occupant exposure to potentially hazardous particulates and chemical pollutants.

Requirements

Design to minimize and control the entry of pollutants into buildings and later cross-contamination of regularly occupied areas through the following strategies:

- Employ permanent entryway systems at least 10 feet long in the primary direction of travel to capture dirt and particulates entering the building at regularly used exterior entrances. Acceptable entryway systems include permanently installed grates, grill s and slotted systems that allow for cleaning underneath. Roll-out mats are acceptable only when maintained on a weekly basis by a contracted service organization.
- Sufficiently exhaust each space where hazardous gases or chemicals may be present or used (e.g., garages, housekeeping and laundry areas, copying and printing rooms) to create negative pressure with respect to adjacent spaces when the doors to the room are closed. For each of these spaces, provide self-closing doors and deck-to-deck partitions or a hard-lid ceiling. The exhaust rate must be at least 0.50 cubic feet per minute (cfm) per square foot with

no air recirculation. The pressure differential with the surrounding spaces must be at least 5 Pascal's (Pa) (0.02 inches of water gauge) on average and 1 Pa (0.004 inches of water) at a minimum when the doors to the rooms are closed.

- In mechanically ventilated buildings, install new air filtration media in regularly occupied areas prior to occupancy; these filters must provide a minimum efficiency reporting value (MERV) of 13 or higher. Filtration should be applied to process both return and outside air that is delivered as supply air.
- Provide containment (i.e. a closed container for storage for off-site disposal in a regulatory compliant storage area, preferably outside the building) for appropriate disposal of hazardous liquid wastes in places where water and chemical concentrate mixing occurs (e.g., housekeeping, janitorial and science laboratories).

Potential Technologies & Strategies

Design facility cleaning and maintenance areas with isolated exhaust systems for contaminants. Maintain physical isolation from the rest of the regularly occupied areas of the building. Install permanent architectural entryway systems such as grills or grates to prevent occupant-borne contaminants from entering the building. Install high-level filtration systems in air handling units processing both return air and outside supply air. Ensure that air handling units can accommodate required filter sizes and pressure drops.

4.5.12 IEQ Credit 6.1: Controllability of Systems—Lighting 1 Point [EHS Mandatory]

Intent

To provide a high level of lighting system control by individual occupants or groups in multi-occupant spaces (e.g., classrooms and conference areas) and promote their productivity, comfort and well-being.

Requirements

Provide individual lighting controls for 90% (minimum) of the building occupants to enable adjustments to suit individual task needs and preferences.

Provide lighting system controls for all shared multi-occupant spaces to enable adjustments that meet group needs and preferences.

Potential Technologies & Strategies

Design the building with occupant controls for lighting. Strategies to consider include lighting controls and task lighting. Integrate lighting systems controllability into the overall lighting design, providing ambient and task lighting while managing the overall energy use of the building.

4.5.13 IEQ Credit 6.2: Controllability of Systems—Thermal Comfort [1 point]

Intent

To provide a high level of thermal comfort system control¹ by individual occupants or groups in multi-occupant spaces (e.g., classrooms or conference areas) and promote their productivity, comfort and well-being.

Requirements

Provide individual comfort controls for 50% (minimum) of the building occupants to enable adjustments to meet individual needs and preferences. Operable windows may be used in lieu of controls for occupants located 20 feet inside and 10 feet to either side of the operable part of a window. The areas of operable window must meet the requirements of ASHRAE Standard 62.1-2007 paragraph 5.1 Natural Ventilation (with errata but without addenda*).

Provide comfort system controls for all shared multi-occupant spaces to enable adjustments that meet group needs and preferences.

Conditions for thermal comfort are described in ASHRAE Standard 55-2004 (with errata but without addenda²) and include the primary factors of air temperature, radiant temperature, air speed and humidity.

Potential Technologies & Strategies

Design the building and systems with comfort controls to allow adjustments to suit individual needs or those of groups in shared spaces. ASHRAE Standard 55-2004 (with errata but without addenda²) identifies the factors of thermal comfort and a process for developing comfort criteria for building spaces that suit the needs of the occupants involved in their daily activities. Control strategies can be developed to expand on the comfort criteria and enable individuals to make adjustments to suit their needs and preferences. These strategies may involve system designs incorporating operable windows, hybrid systems integrating operable windows and mechanical systems, or mechanical systems alone.

Individual adjustments may involve individual thermostat controls, local diffusers at floor, desk or overhead levels, control of individual radiant panels or other means integrated into the overall building, thermal comfort systems and energy systems design. Designers should evaluate the closely tied interactions between thermal comfort as required by ASHRAE Standard 55-2004 (with errata but without addenda²) and acceptable indoor air quality as required by ASHRAE Standard 62.1-2007 (with errata but without addenda), whether natural or mechanical ventilation.

4.5.14 IEQ Credit 7.1: Thermal Comfort—Design 1 Point [EHS Mandatory]

Intent

To provide a comfortable thermal environment that promotes occupant productivity and well-being.

Requirements

Design heating, ventilating and air conditioning (HVAC) systems and the building envelope to meet the requirements of ASHRAE Standard 55-2004, Thermal Comfort Conditions for Human Occupancy (with errata but without addenda1). Demonstrate design compliance in accordance with the Section 6.1.1 documentation.

Potential Technologies & Strategies

Establish comfort criteria according to ASHRAE 55-2004 (with errata but without addenda) that support the desired quality and occupant satisfaction with building performance. Design the building envelope and systems with the capability to meet the comfort criteria under expected environmental and use conditions. Evaluate air temperature, radiant temperature, air speed and relative humidity in an integrated fashion, and coordinate these criteria with IEQ Prerequisite 1: Minimum IAQ Performance, IEQ Credit 1: Outdoor Air Delivery Monitoring, and IEQ Credit 2: Increased Ventilation.

4.5.15 IEQ Credit 7.2: Thermal Comfort—Verification 1 point in addition to IEQ credit 7.1 [EHS Mandatory]

Intent

To provide for the assessment of building occupant thermal comfort over time.

Requirements

Achieve IEQ Credit 7.1: Thermal Comfort—Design

Provide a permanent monitoring system to ensure that building performance meets the desired comfort criteria as determined by IEQ Credit 7.1: Thermal Comfort—Design.

Agree to conduct a thermal comfort survey of building occupants within 6 to 18 months after occupancy. This survey should collect anonymous responses about thermal comfort in the building, including an assessment of overall satisfaction with thermal performance and identification of thermal comfort-related problems. Agree to develop a plan for corrective action if the survey results indicate that more than 20% of occupants are dissatisfied with thermal comfort in the building. This plan should include measurement of relevant environmental variables in problem areas in accordance with ASHRAE Standard 55-2004 (with errata but without addenda*).

Residential projects are not eligible for this credit.

Potential Technologies & Strategies

ASHRAE 55-2004 provides guidance for establishing thermal comfort criteria and documenting and validating building performance to the criteria. While the standard is not intended for purposes of continuous monitoring and maintenance of the thermal environment, the principles expressed in the standard provide a basis for the design of monitoring and corrective action systems.

4.5.16 IEQ Credit 8.1: Daylight and Views—Daylight [1 point]

Intent

To provide building occupants with a connection between indoor spaces and the outdoors through the introduction of daylight and views into the regularly occupied areas of the building.

Requirements

Through 1 of the 4 options, achieve day lighting in at least the following spaces:

Regularly occupied spaces	points
75 %	1

OPTION 1. Simulation

Demonstrate through computer simulations that 75% or more of all regularly occupied spaces areas achieve daylight illuminance levels of a minimum of 25 foot-candles (fc) and a maximum of 500 fc in a clear sky condition on September 21 at 9 a.m. and 3 p.m. Areas with illuminance levels below or above the range do not comply.

However, designs that incorporate view-preserving automated shades for glare control may demonstrate compliance for only the minimum 25 fc illuminance level.

OR

OPTION 2. Prescriptive


Use a combination of side-lighting and/or top-lighting to achieve a total daylighting zone (the floor area meeting the following requirements) that is at least 75% of all the regularly occupied spaces.

For the Side-lighting Daylight Zone (see diagram below):

- Achieve a value, calculated as the product of the visible light transmittance (VLT) and window-to-floor area ratio (WFR) of daylight zone between 0.150 and 0.180. The window area included in the calculation must be at least 30 inches above the floor.


$$0.150 < VLT \times WFR < 0.180$$

- The ceiling must not obstruct a line in section that joins the window-head to a line on the floor that is parallel to the plane of the window; is twice the height of the window-head above the floor in, distance from the plane of the glass as measured perpendicular to the plane of the glass.
- Provide sunlight redirection and/or glare control devices to ensure daylight effectiveness

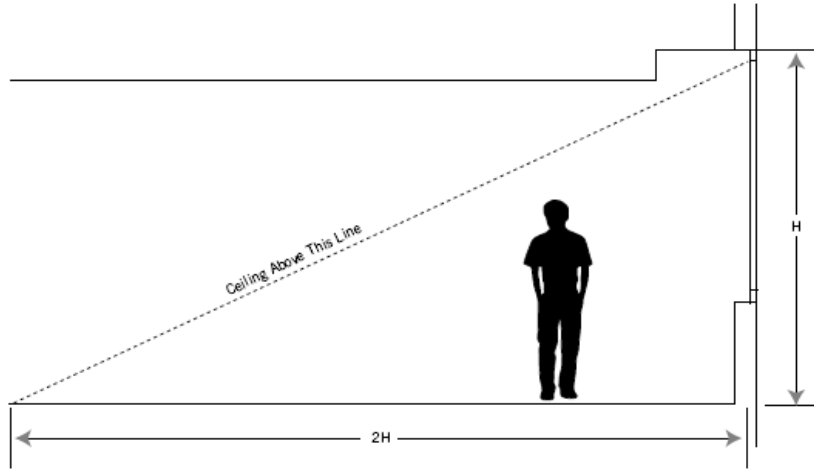

For Top-lighting Daylight Zone (see diagram above):

- The daylight zone under a skylight is the outline of the opening beneath the skylight, plus in each direction the lesser of:
 - 70% of the ceiling height,OR
 - 1/2 the distance to the edge of the nearest skylight,OR
 - The distance to any permanent opaque partition (if transparent show VLT) farther than 70% of the distance between the top of the partition and the ceiling. - Achieve skylight roof coverage between 3% and 6% of the roof area with a minimum 0.5 VLT.
 - The distance between the skylights must not be more than 1.4 times the ceiling height.
 - A skylight diffuser, if used, must have a measured haze value of greater than 90% when tested according to ASTM D1003. Avoid direct line of sight to the skylight diffuser.
- Exceptions for areas where tasks would be hindered by the use of daylight will be considered on their merits.

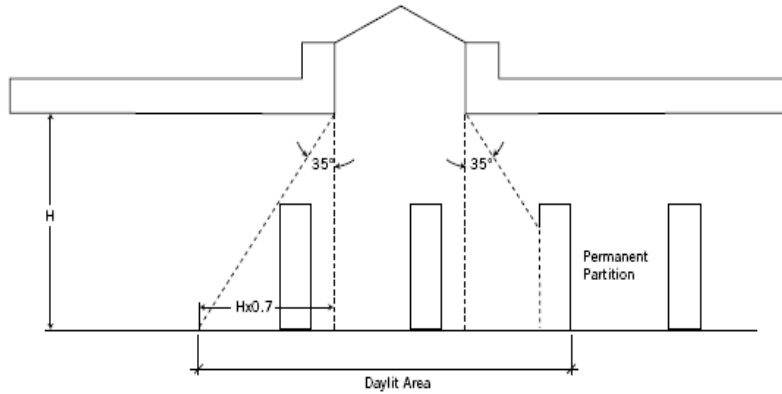

OR

OPTION 3. Measurement

Demonstrate through records of indoor light measurements that a minimum daylight illumination level of 25 fc has been achieved in at least 75% of all regularly occupied areas. Measurements must be taken on a 10-foot grid for all occupied spaces and recorded on building floor plans.

Only the square footage associated with the portions of rooms or spaces meeting the minimum illumination requirements may be counted in the calculations.

For all projects pursuing this option, provide daylight redirection and/or glare control devices to avoid high contrast situations that could impede visual tasks. Exceptions for areas where tasks would be hindered by daylight will be considered on their merits.

OR

OPTION 4. Combination

Any of the above calculation methods may be combined to document the minimum daylight illumination in at least 75% of all regularly occupied spaces. The different methods used in each space must be clearly recorded on all building plans.

In all cases, only the square footage associated with the portions of rooms or spaces meeting the requirements may be applied toward the 75% of total area calculation required to qualify for this credit.

In all cases, provide glare control devices to avoid high-contrast situations that could impede visual tasks. Exceptions for areas where tasks would be hindered by the use of daylight will be considered on their merits.

Potential Technologies & Strategies

Design the building to maximize interior day lighting. Strategies to consider include building

orientation, shallow floor plates, increased building perimeter, exterior and interior permanent shading devices, high-performance glazing, and high-ceiling reflectance values; Additionally, automatic photocell-based controls can help to reduce energy use. Predict daylight factors via manual calculations or model day lighting strategies with a physical or computer model to assess foot candle levels and daylight factors achieved.

4.5.17 IEQ Credit 8.2: Daylight and Views—Views [1 point]

Intent

To provide building occupants a connection to the outdoors through the introduction of daylight and views into the regularly occupied areas of the building.

Requirements

Achieve a direct line of sight to the outdoor environment via vision glazing between 30 inches and 90 inches above the finish floor for building occupants in 90% of all regularly occupied areas. Determine the area with a direct line of sight by totaling the regularly occupied square footage that meets the following criteria:

- In plan view, the area is within sight lines drawn from perimeter vision glazing.
- In section view, a direct sight line can be drawn from the area to perimeter vision glazing.

The line of sight may be drawn through interior glazing. For private offices, the entire square footage of the office may be counted if 75% or more of the area has a direct line of sight to perimeter vision glazing. For multi-occupant spaces, the actual square footage with a direct line of sight to perimeter vision glazing is counted.

Potential Technologies & Strategies

Design the space to maximize day lighting and view opportunities. Strategies to consider include lower partitions, interior shading devices, interior glazing and automatic photocell-based controls.

Regulation GB-4.6: Innovation

4.6.1 ID Credit 1: Innovation in Design [1–5 Points]

Intent

To provide design teams and projects the opportunity to achieve exceptional performance above the requirements set by the LEED Green Building Rating System and/or innovative performance in Green Building categories not specifically addressed by the LEED Green Building Rating System.

Requirements

Credit can be achieved through any combination of the Innovation in Design and Exemplary Performance paths as described below:

PAT H 1. Innovation in Design (1-5 points)

Achieve significant, measurable environmental performance using a strategy not addressed in the LEED 2009 for New Construction and Major Renovations Rating System.

One point is awarded for each innovation achieved. No more than 5 points under IDc1 may be earned through PATH 1—Innovation in Design.

Identify the following in writing:

- The intent of the proposed innovation credit.
- The proposed requirement for compliance.
- The proposed submittals to demonstrate compliance.
- The design approach (strategies) used to meet the requirements.

PAT H 2. Exemplary Performance (1-3 points)

Achieve exemplary performance in an existing LEED 2009 for New Construction and Major Renovations prerequisite or credit that allows exemplary performance as specified in the LEED Reference Guide for Green Building Design & Construction, 2009 Edition. An exemplary performance point may be earned for achieving double the credit requirements and/or achieving the next incremental percentage threshold of an existing credit in LEED.

One point is awarded for each exemplary performance achieved. No more than 3 points under IDc1 may be earned through PATH 2— Exemplary Performance.

Potential Technologies & Strategies

Substantially exceed a LEED 2009 for New Construction and Major Renovations performance credit such as energy performance or water efficiency. Apply strategies or measures that demonstrate a comprehensive approach and quantifiable environment and/or health benefits.

4.6.2 ID Credit 2: LEED Accredited Professional - 1 Point [EHS Mandatory]

Intent

To support and encourage the design integration required by LEED to streamline the application and certification process.

Requirements

At least 1 principal participant of the project team shall be a LEED Accredited Professional (AP).

Potential Technologies & Strategies

Educate the project team members about green building design and construction, the LEED requirements and application process early in the life of the project. Consider assigning integrated design and construction process facilitation to the LEED AP.

Regulation GB-4.7: EHS Green Building Regulations (Workup Table)

4.7.1 SUSTAINABLE SITES (26 POSSIBLE POINTS)

PreReq 1	Construction Activity Pollution Prevention	Required	EHS Mandatory
Credit 1	Site Selection(Subject to EHS Approval	1	EHS Mandatory
Credit 2	Development Density and Community Connectivity	5	
Credit 3	Brownfield Redevelopment	1	
Credit 4.1	Alternative Transportation-public transportation access	6	
Credit 4.2	Alternative Transportation, Bicycle Storage & Changing Rooms	1	
Credit 4.3	Alternative Transportation, Low Emitting & Fuel Efficient Vehicles	3	
Credit 4.4	Alternative Transportation, Parking Capacity	2	EHS Mandatory
Credit 5.1	Site Development, Protect or Restore Habitat	1	EHS Mandatory
Credit 5.2	Site Development, Maximize Open Space	1	
Credit 6.1	Stormwater Design, Quantity Control	1	
Credit 6.2	Stormwater Design, Quantity Control	1	
Credit 7.1	Heat Island Effect, Non-Roof	1	EHS Mandatory
Credit 7.2	Heat Island Effect, Roof	1	EHS Mandatory
Credit 8	Light Pollution Reduction	1	EHS Mandatory

Total Mandatory Points 7

4.7.2 WATER EFFICIENCY (10 POSSIBLE POINTS)

PreReq 1	Water Use Reduction	Required	EHS Mandatory
Credit 1	Water Efficient Landscaping	2-4	EHS Mandatory (2)
Credit 2	Innovative Wastewater Technologies	2	EHS Mandatory
Credit 3	Water Use Reduction	2-4	EHS Mandatory (2)

Total Mandatory Points 6

4.7.3 ENERGY & ATMOSPHERE (35 POSSIBLE POINTS)

Pre Req 1	Fundamental Commissioning of the Building Energy Systems	Required	EHS Mandatory
Pre Req 2	Minimum Energy Performance	Required	EHS Mandatory
Pre Req 3	Fundamental Refrigerant Management	Required	EHS Mandatory
Credit 1	Optimize Energy Performance	1-19	EHS Mandatory (6)
Credit 2	On-Site Renewable Energy	1-7	
Credit 3	Enhanced Commissioning	2	EHS Mandatory
Credit 4	Enhanced Refrigerant Management	2	EHS Mandatory
Credit 5	Measurement & Verification	3	EHS Mandatory
Credit 6	Green Power	2	

Total Mandatory Points 14

4.7.4 MATERIALS & RESOURCES (14 POSSIBLE POINTS)

Pre Req	Storage & Collection of Recyclables	Required	EHS Mandatory
Credit 1.1	Building Reuse, Maintain Existing Walls, Floors & Roof	1-3	
Credit 1.2	Building Reuse, Maintain of Interior Non-Structural Elements	1	
Credit 2	Construction Waste Management	1-2	EHS Mandatory (1)
Credit 3	Materials Reuse	1-2	
Credit 4	Recycled Content	1-2	EHS Mandatory (1)
Credit 5	Regional Materials	1-2	
Credit 6	Rapidly Renewable Materials	1	
Credit 7	Certified Wood	1	

Total Mandatory Points 2

4.7.5 Indoor Environmental Quality (15 POSSIBLE POINTS)

Pre Req 1	Minimum IAQ Performance	Required	EHS Mandatory
Pre Req 2	Environmental Tobacco Smoke (ETS) Control	Required	EHS Mandatory
Credit 1	Outdoor Air Delivery Monitoring	1	EHS Mandatory
Credit 2	Increased Ventilation	1	
Credit 3.1	Construction IAQ Management Plan, During Construction	1	EHS Mandatory
Credit 3.2	Construction IAQ Management Plan, Before Occupancy	1	EHS Mandatory
Credit 4.1	Low-Emitting Materials, Adhesives & Sealants	1	EHS Mandatory
Credit 4.2	Low-Emitting Materials, Paints & Coatings	1	
Credit 4.3	Low-Emitting Materials, flooring Systems	1	
Credit 4.4	Low-Emitting Materials, Composite Wood & Agrifiber Products	1	
Credit 5	Indoor Chemical & Pollutant Source Control	1	EHS Mandatory
Credit 6.1	Controllability of Systems, Lighting	1	EHS Mandatory
Credit 6.2	Controllability of Systems, Thermal Comfort	1	
Credit 7.1	Thermal Comfort, Design	1	EHS Mandatory
Credit 7.2	Thermal Comfort, Verification	1	EHS Mandatory
Credit 8.1	Daylight & Views, Daylight	1	
Credit 8.2	Daylight & Views, Views	1	

Total Mandatory Points 8

4.7.6 INNOVATION IN DESIGN (6 POSSIBLE POINTS)

Credit 1	Innovation in Design	1-5	
Credit 2	LEED Accredited Professional	1	EHS Mandatory

Total Mandatory Points 1

Note

1) Projects governed by this regulation should seek a minimum certification level in addition to complying with the mandatory credits